

Public-law institution jointly founded by the
federal states and the Federation

European Technical Assessment Body
for construction products



European Technical Assessment

ETA-17/0307
of 15 September 2025

English translation prepared by DIBt - Original version in German language

General Part

Technical Assessment Body issuing the
European Technical Assessment:

Deutsches Institut für Bautechnik

Trade name of the construction product

Sikla Injection system VMU plus for masonry

Product family
to which the construction product belongs

Metal Injection anchors for use in masonry

Manufacturer

Sikla Holding GmbH
Ägydiplatz 3
A-4600 THALHEIM BEI WELS
ÖSTERREICH

Manufacturing plant

Sikla Herstellwerk 1
Sikla Herstellwerk 3

This European Technical Assessment
contains

81 pages including 3 annexes which form an integral part
of this assessment

This European Technical Assessment is
issued in accordance with Regulation (EU)
No 305/2011, on the basis of

EAD 330076-01-0604, Edition 10/2022

This version replaces

ETA-17/0307 issued on 4 May 2017

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

Specific Part

1 Technical description of the product

The "Sikla Injection System VMU plus for masonry" is a bonded anchor (injection type) consisting of a mortar cartridge with injection mortar VMU plus or VMU plus Polar, a perforated sleeve and an anchor rod with hexagon nut and washer or an Internal threaded rod. The steel elements are made of zinc coated steel, stainless steel or high corrosion resistant steel.

The anchor rod is placed into a drilled hole filled with injection mortar and is anchored via the bond between steel element, injection mortar and masonry and mechanical interlock.

The product description is given in Annex A.

2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the fastener is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the fastener of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

3 Performance of the product and references to the methods used for its assessment

3.1 Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Characteristic resistance for static and quasi-static loading	See Annexes B6, B7 C1 to C60
Characteristic resistance and displacements for seismic loading	No performance assessed

3.2 Safety in case of fire (BWR 2)

Essential characteristic	Performance
Reaction to fire	Class A1
Resistance to fire under tension and shear loading with and without lever arm. Minimum edge distances and spacing	See Annexes C4, C9, C10, C15, C16, C19, C21, C22, C23, C40, C42, C47, C48, C49, C50, C55 and C56

3.3 Hygiene, health and the environment (BWR 3)

Essential characteristic	Performance
Content, emission and/or release of dangerous substances	No performance assessed

4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

In accordance with the European Assessment Document EAD 330076-01-0604 the applicable European legal act is: [97/177/EC].

The system to be applied is: 1

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at Deutsches Institut für Bautechnik.

Issued in Berlin on 15 September 2025 by Deutsches Institut für Bautechnik

Dipl.-Ing. Beatrix Wittstock
Head of Section




beglaubigt:
Baderschneider

Installation in solid brick with or without non-loadbearing layer

Threaded rod M8 – M16 / Internally threaded anchor rod IG-M6 – IG-M10

Pre-setting installation




Through-setting installation

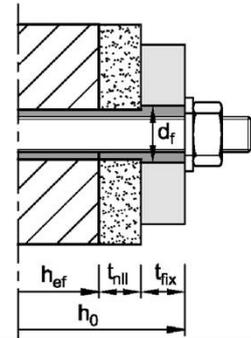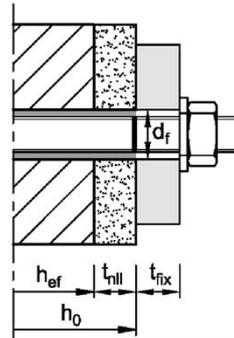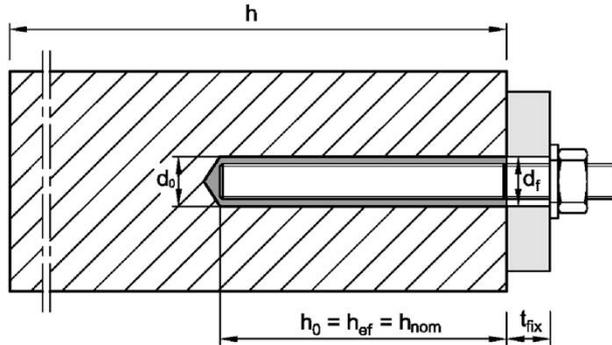

Threaded rod M8 – M16 / Internally threaded anchor rod IG-M6 – IG-M10 with sleeve

Pre-setting installation

Through-setting installation

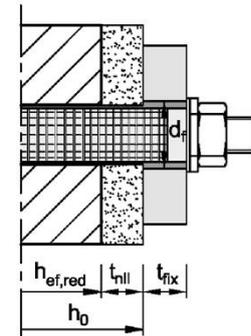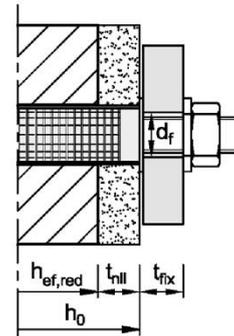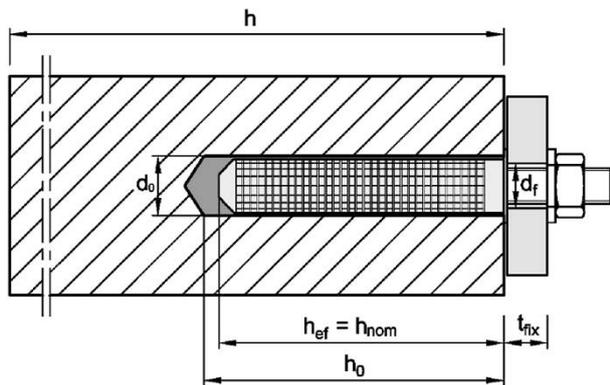

For through-setting installation, the annular gap between the anchor rod and the fixture must be filled with mortar.

Legend (Annex A1 and Annex A2):

- h_{ef} = effective anchorage depth
- h_{nom} = overall anchor embedment depth
- h_0 = depth of drill hole
- h = thickness of masonry member
- d_0 = nominal drill hole diameter
- d_f = diameter of clearance hole in the fixture
- t_{fix} = thickness of fixture
- t_{nll} = thickness of non-loadbearing layer

Sikla Injection System VMU plus for masonry

Product description
Installation condition – solid brick


Annex A1

Installation in hollow brick with or without non-loadbearing layer

Threaded rod M8 – M16 / Internally threaded anchor rod IG-M6 – IG-M10 with sleeve

Pre-setting installation

Through-setting installation

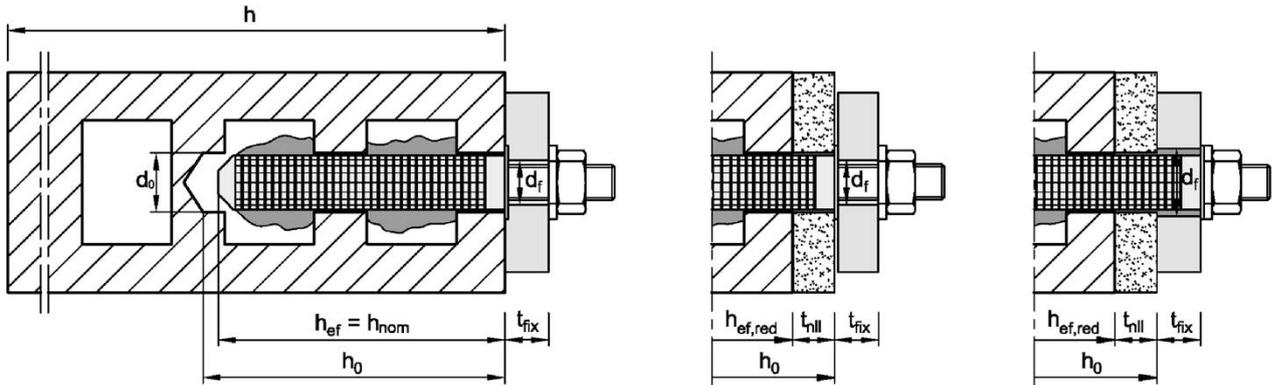


Installation in hollow brick with or without non-loadbearing layer and/or thermal isolation

Threaded rod M8 – M10 / Internally threaded anchor rod IG-M6 with sleeve SH 16x130/330


Pre-setting installation

Through-setting installation

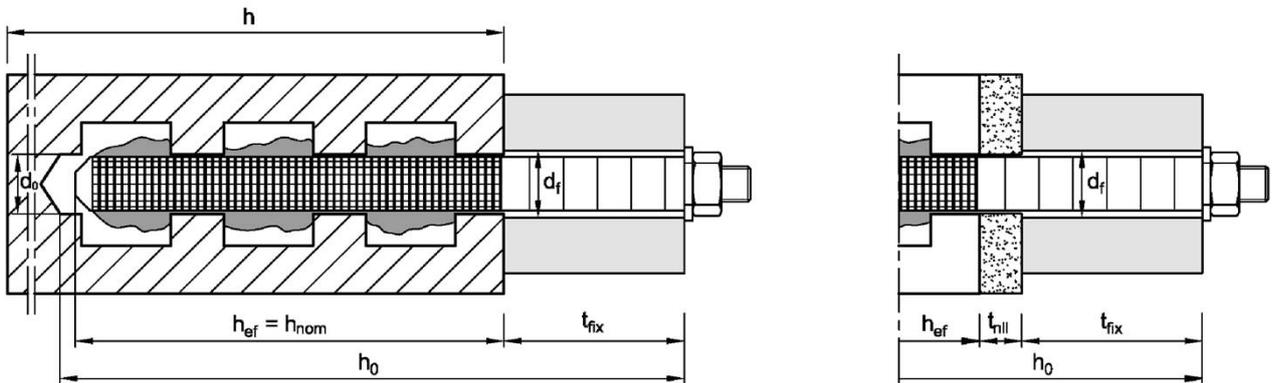

Pre-setting installation

Through-setting installation

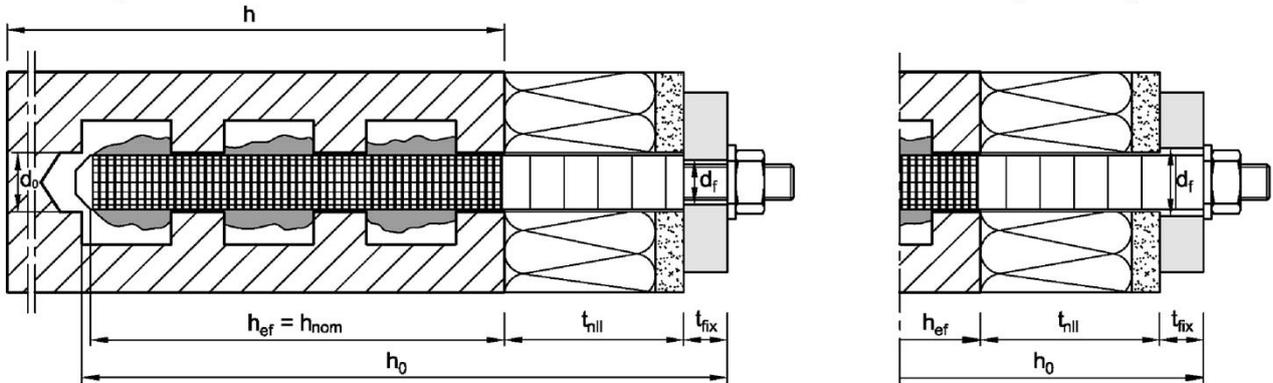

Sikla Injection System VMU plus for masonry

Product description
Installation condition – hollow brick

Annex A2

Cartridge: Injection mortar VMU plus or VMU plus Polar


Coaxial cartridge

150 ml, 160ml, 280 ml,
300 ml to 330 ml,
380 ml to 420 ml



Side-by-side cartridge

235 ml,
345 ml to 360 ml,
825 ml

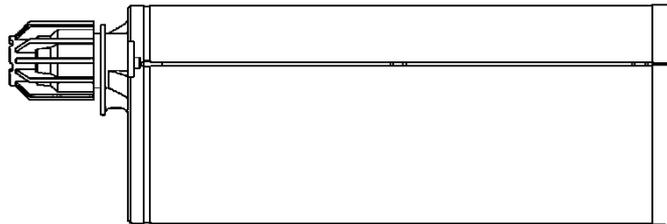

Foil tube cartridge

165 ml
300 ml




Cartridge imprint:


VMU plus or VMU plus Polar
processing and safety instructions, shelf life, charge number, manufacturer's information, quantity information

Static mixer


VM-X

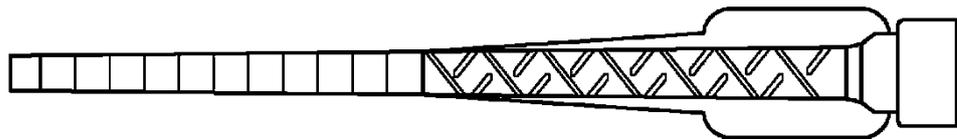

VM-XHP



Mixer extension



Sikla Injection System VMU plus for masonry

Product description
Injection system


Annex A3

Threaded rod


Threaded rod VMU-A and V-A

M8, M10, M12, M16 (zinc plated, A4, HCR)
with washer and hexagon nut

VMU-A

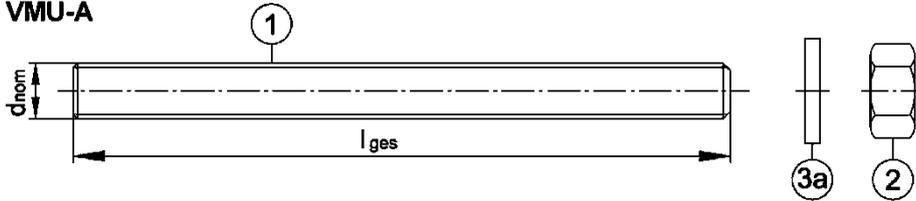

V-A

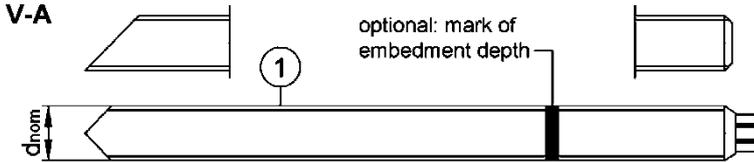

Marking e.g.: \diamond M10

\diamond identifying mark of manufacturing plant

M10 size of thread

additional marking:

-8 strength class 8.8

A4 stainless steel

HC high corrosion resistant steel

Threaded rod VM-A (material sold by the metre, to be cut at the required length)

M8, M10, M12, M16 (zinc plated, A2, A4, HCR)

- Materials, dimensions and mechanical properties see Table A1

Commercial standard threaded rod with:

M8, M10, M12, M16 (zinc plated, A2, A4, HCR)


- Materials, dimensions and mechanical properties see Table A1

- Inspection certificate 3.1 acc. to EN 10204:2004 (documents must be retained)


Internally threaded anchor rod VMU-IG and VZ-IG

IG M6, IG M8, IG M10
(zinc plated, A4, HCR)

VMU-IG

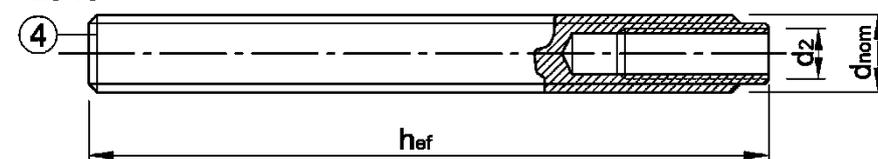

VZ-IG

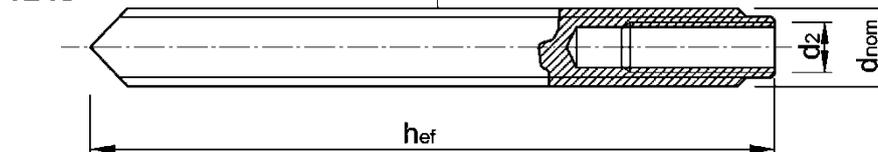

Marking e.g.: \diamond M8

\diamond identifying mark of manufacturing plant

I internal thread (optional)

M8 size of internal thread

additional marking:

-8 strength class 8.8

A4 stainless steel

HCR high corrosion resistant steel

Sikla Injection System VMU plus for masonry

Product description

Threaded rods and internally threaded anchor rods

Annex A4

Table A1: Material

Part	Designation	Material and mechanical properties						
Steel, zinc plated								
electroplated		≥ 5 µm acc. to EN ISO 4042:2022 or						
hot-dip galvanized		≥ 50 µm in average acc. to EN ISO 1461:2022, EN ISO 10684:2004+AC:2009 or						
sherardized		≥ 45 µm acc. to EN ISO 17668:2016						
1	Threaded rod	Property class	characteristic ultimate strength		characteristic yield strength		fracture elongation	EN ISO 683-4:2018, EN 10263:2017 Commercial standard threaded rod: EN ISO 898-1:2013
		4.6	f_{uk} [N/mm ²]	400	f_{yk} [N/mm ²]	240	A ₅ > 8 %	
		4.8		400		320	A ₅ > 8 %	
		5.6		500		300	A ₅ > 8 %	
		5.8		500		400	A ₅ > 8 %	
8.8	800	640		A ₅ > 8 %				
2	Hexagon nut	4	for class 4.6 or 4.8 rods				EN ISO 898-2:2022	
		5	for class 4.6, 4.8, 5.6 or 5.8 rods					
		8	for class 4.6, 4.8, 5.6, 5.8 or 8.8 rods					
3	Washer	e.g.: EN ISO 7089:2000, EN ISO 7093:2000, EN ISO 7094:2000, EN ISO 887:2006						
4	Internally threaded anchor rod ³⁾	5.8	Steel, electroplated or sherardized			A ₅ > 8%	EN ISO 683-4:2018	
		8.8				A ₅ > 8%		
Stainless steel A2¹⁾		CRC II (1.4301 / 1.4307 / 1.4311 / 1.4567 / 1.4541)						
Stainless steel A4		CRC III (1.4401 / 1.4404 / 1.4571 / 1.4578)						
High corrosion resistant steel HCR		CRC V (1.4529 / 1.4565)						
1	Threaded rod	Property class	characteristic ultimate strength		characteristic yield strength		fracture elongation	EN 10088-1:2014 EN ISO 3506-1:2020
		50	f_{uk} [N/mm ²]	500	f_{yk} [N/mm ²]	210	A ₅ > 8%	
		70		700		(560) ²⁾	A ₅ > 8%	
80	800	(640) ²⁾		A ₅ > 8%				
2	Hexagon nut	50	for class 50 rods				EN 10088-1:2014 EN ISO 3506-2:2020	
		70	for class 50 or 70 rods					
		80	for class 50, 70 or 80 rods					
3	Washer	e.g.: EN ISO 7089:2000, EN ISO 7093:2000, EN ISO 7094:2000; EN ISO 887:2006						
4	Internally threaded anchor rod ³⁾	70	stainless steel A4; high corrosion resistant steel HCR			A ₅ > 8%	EN 10088-1:2014	
Perfo Sleeve VM-SH		Polypropylene (PP)						

¹⁾ Property class 50 and 70

²⁾ Value in brackets for anchor rods VMU-A and V-A

³⁾ Using VMU-IG or VZ-IG, screws or threaded rods (incl. nut and washer) must at least correspond to the material and strength class of the internally threaded anchor rod used.

Sikla Injection System VMU plus for masonry




Product description
Materials

Annex A5

Table A2: Dimensions of threaded rods and internally threaded anchor rods

Threaded rod		M8	M10	M12	M16
Diameter	$d = d_{nom}$ [mm]	8	10	12	16
Total length	l_{ges} [mm]	$h_{ef} + t_{fix} + 9,5$	$h_{ef} + t_{fix} + 11,5$	$h_{ef} + t_{fix} + 17,5$	$h_{ef} + t_{fix} + 20,0$
Internally threaded anchor rod		-	IG M6	IG M8	IG M10
Internal diameter	d_2 [mm]	-	6	8	10
Outer diameter	$d = d_{nom}$ [mm]	-	10	12	16
min. screw-in depth	$L_{IG,min}$ [mm]	-	8	10	10
Total length	l_{ges} [mm]	-	with sleeve: $h_{ef} - 5mm$ without sleeve: h_{ef}		

Table A3: Dimensions of sleeves VM-SH

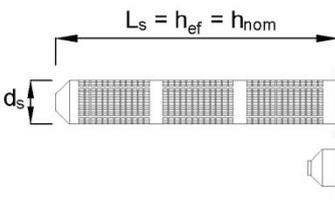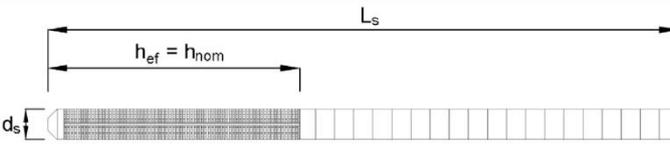Type	Size	d_s [mm]	L_s [mm]	$h_{ef} = h_{nom}$ [mm]
	VM-SH 12x80	12	80	80
	VM-SH 16x85	16	85	85
	VM-SH 20x85	20	85	85
	VM-SH 16x130	16	130	130
	VM-SH 20x130	20	130	130
	VM-SH 20x200	20	200	200
 for installation through insulation up to a thickness of 20 cm or through-setting installation	VM-SH 16x130/330 ¹⁾	16	330	130

¹⁾ In Annex C this sleeve is covered with the VM-SH 16x130

Sikla Injection System VMU plus for masonry

Product description
Dimensions of threaded rods and sleeves

Annex A6

Specifications of intended use

Anchorage subject to	Static and quasi-static loads		M8 – M16 IG M6 – IG M10 (with and without sleeve)
	Fire exposure		
	Tension and shear loads		
Base Material	Masonry group b:	Solid brick masonry	Annex B 3
	Masonry group c:	Hollow brick masonry	Annex B 3 to B 5
	Masonry group d:	Autoclaved Aerated Concrete	Annex B 3
	Mortar strength class of the masonry M2,5 at minimum according to EN 998-2:2016 For other bricks in solid masonry, hollow masonry or in autoclaved aerated concrete, the characteristic resistance of the anchor may be determined by job site tests according to EOTA TR 053, Edition July 2022 under consideration of the β -factor according to Annex C1, Table C1		
Temperature range	<p>T_a: - 40°C to +40°C (max. short term temperature +40°C and max. long term temperature +24°C)</p> <p>T_b: - 40°C to +80°C (max. short term temperature +80°C and max. long term temperature +50°C)</p> <p>T_c: - 40°C to +120°C (max. short term temperature +120°C and max. long term temperature +72°C)</p>		
Hole drilling	See Annex C		
Use conditions (Environmental conditions):	Structures subject to dry internal conditions (all materials). For all other conditions acc. to EN 1993-1-4:2006+ A2:2020 corresponding to corrosion resistance classes Annex A (stainless steel and high corrosion resistant steel)		
Use category	<ul style="list-style-type: none"> • Condition d/d Installation and use in dry masonry • Condition w/w Installation and use in dry or wet masonry (incl. w/d, installation in wet masonry and use in dry masonry) 		

Note: The characteristic resistance for solid bricks and autoclaved aerated concrete are also valid for larger brick sizes and larger compressive strength of the masonry unit.

Sikla Injection System VMU plus for masonry

**Intended Use
Specifications**

Annex B1

Specifications of intended use (continued)

Design:


- Verifiable calculation notes and drawings are prepared taking account the relevant masonry in the region of the anchorage, the loads to be transmitted and their transmission to the supports of the structure. The position of the anchor is indicated on the design drawings.
- The anchorages are designed in accordance with the EOTA TR 054, Edition July 2022, under the responsibility of an engineer experienced in anchorages and masonry work.
- Applies to all bricks if no other values are specified:
 - $N_{Rk} = N_{Rk,b} = N_{Rk,p} = N_{Rk,b,c} = N_{Rk,p,c}$
 - $V_{Rk} = V_{Rk,b} = V_{Rk,c,II} = V_{Rk,c,\perp}$
- For the calculation of pulling out a brick under tension loading $N_{Rk,pb}$ or pushing out a brick under shear loading $V_{Rk,pb}$ see EOTA Technical Report TR 054, Edition July 2022.
- $N_{Rk,s}$, $V_{Rk,s}$ and $M^0_{Rk,s}$ see annexes C2 – C4
- For application with sleeve with drill bit size $\leq 15\text{mm}$ installed in joints not filled with mortar:
 - $N_{Rk,p,j} = 0,18 * N_{Rk,p}$ and $N_{Rk,b,j} = 0,18 * N_{Rk,b}$ ($N_{Rk,p} = N_{Rk,b}$ see Annex C)
 - $V_{Rk,c,j} = 0,15 * V_{Rk,c}$ and $V_{Rk,b,j} = 0,15 * V_{Rk,b}$ ($V_{Rk,b}$ see Annex C; and $V_{Rk,c}$ see Annex C5)
- Applications without sleeve installed in unfilled joints are not permitted.

Installation:

- Anchor Installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site
- Using internally threaded anchor rod (VMU-IG or VZ-IG) screws and threaded rods (incl. nut and washer) must at least correspond to the material and strength class of the internally threaded anchor rod used.

Sikla Injection System VMU plus for masonry	Annex B2
Intended use Specifications	

Table B1: Overview brick types and properties


Designation Density [kg/dm ³] Dimension LxBxH [mm]	Picture	Perfo Sleeve VM-SH	Fire exposure	Annex	Designation Density [kg/dm ³] Dimension LxBxH [mm]	Picture	Perfo Sleeve VM-SH	Fire exposure	Annex
Hollow light weight concrete brick acc. to EN 771-4:2011+A1:2015					Hollow light weight concrete brick acc. to EN 771-3:2011+A1:2015				
AAC $\rho = 0,35-0,60$ $\geq 499 \times 240 \times 249$		12x80 16x85 16x130 20x85 20x130 20x200	-	C6 - C8	VBL $\rho \geq 0,6$ $\geq 240 \times 300 \times 113$		12x80 16x85 16x130 20x85 20x130 20x200	-	C59 - C60
Hollow light weight concrete brick acc. to EN 771-3: 2011+A1:2015									
HBL 16DF $\rho \geq 1,0$ 500x250x240		16x85 16x130 20x85 20x130 20x200	✓	C55 - C56	Bloc creux B40 $\rho \geq 0,8$ 495x195x190		16x130 20x130	-	C57 - C58
Calcium silica bricks acc. to EN 771-2:2011+A1:2015									
KS-NF $\rho \geq 2,0$ $\geq 240 \times 115 \times 71$		12x80 16x85 16x130 20x85 20x130 20x200	✓	C9 - C10	KSL-3DF $\rho \geq 1,4$ 240x175x113		16x85 16x130 20x85 20x130	-	C11 - C12
KSL-8DF $\rho \geq 1,4$ 248x240x238		16x130 20x130 20x200	-	C13 - C14	KSL-12DF $\rho \geq 1,4$ 498x175x238		16x130 20x130	✓	C15 - C16
Solid clay bricks acc. to EN 771-1:2011+A1:2015									
MZ-1DF $\rho \geq 2,0$ $\geq 240 \times 115 \times 55$		12x80 16x85 16x130 20x85 20x130 20x200	-	C17 - C18	MZ – 2 DF $\rho \geq 2,0$ $\geq 240 \times 115 \times 113$		12x80 16x85 16x130 20x85 20x130 20x200	✓	C19 - C21

Sikla Injection System VMU plus for masonry

Intended use
Brick types and properties

Annex B3

Continuation Table B1: Overview brick types and properties


Designation Density [kg/dm ³] Dimension LxBxH [mm]	Picture	Perfo Sleeve VM-SH	Fire exposure	Annex	Designation Density [kg/dm ³] Dimension LxBxH [mm]	Picture	Perfo Sleeve VM-SH	Fire exposure	Annex
Hollow clay bricks acc. to EN 771-1:2011+A1:2015									
Hlz-10DF $\rho \geq 1,25$ 300x240x249		12x80 16x85 16x130 20x85 20x130 20x200	✓	C22 - C23	Porotherm Homebric $\rho \geq 0,7$ 500x200x299		12x80 16x85 16x130 20x85 20x130	-	C24 - C25
BGV Thermo $\rho \geq 0,6$ 500x200x314		12x80 16x85 16x130 20x85 20x130	-	C26 - C27	Brique creuse C40 $\rho \geq 0,7$ 500x200x200		12x80 16x85 16x130 20x85 20x130	-	C32 - C33
Calibric R+ $\rho \geq 0,6$ 500x200x314		12x80 16x85 16x130 20x85 20x130	-	C28 - C29	Blocchi Leggeri $\rho \geq 0,6$ 250x120x250		12x80 16x85 16x130 20x85 20x130	-	C34 - C35
Urbanbric $\rho \geq 0,7$ 560x200x274		12x80 16x85 16x130 20x85 20x130	-	C30 - C31	Doppio Uni $\rho \geq 0,9$ 250x120x120		12x80 16x85 16x130 20x85 20x130	-	C36 - C37
Hollow clay bricks with thermal insulation acc. to EN 771-1:2011+A1:2015									
Coriso WS07 $\rho \geq 0,55$ 248x365x249 Mineral wool		12x80 16x85 16x130 20x85 20x130 20x200	-	C38 - C39	T8 P $\rho \geq 0,56$ 248x365x249 Perlite		12x80 16x85 16x130 20x85 20x130 20x200	-	C43 - C44
T7 MW $\rho \geq 0,59$ 248x365x249 Mineral wool		12x80 16x85 16x130 20x85 20x130 20x200	✓	C40 - C42	MZ90-G $\rho \geq 0,68$ 248x365x249 Mineral wool		12x80 16x85 16x130 20x85 20x130 20x200	-	C45 - C46

Sikla Injection System VMU plus for masonry

Intended use
Brick types and properties

Annex B4

Continuation Table B1: Overview brick types and properties

Designation Density [kg/dm ³] Dimension LxBxH [mm]	Picture	Perfo Sleeve VM-SH	Fire exposure	Annex	Designation Density [kg/dm ³] Dimension LxBxH [mm]	Picture	Perfo Sleeve VM-SH	Fire exposure	Annex
Hollow clay bricks with thermal insulation acc. to EN 771-1:2011+A1:2015									
Poroton FZ7,5 $\rho \geq 0,90$ 248x365x249 Mineral wool		12x80 16x85 16x130 20x85 20x130 20x200	✓	C47 - C48	Poroton FZ9 $\rho \geq 0,90$ 248x365x249 Mineral wool		12x80 16x85 16x130 20x85 20x130 20x200	✓	C49 - C50
Poroton S9 $\rho \geq 0,85$ 248x365x249 Perlite		12x80 16x85 16x130 20x85 20x130 20x200	-	C51 - C52	Thermopor TV8+ $\rho \geq 0,7$ 248x365x249 Mineral wool		12x80 16x85 16x130 20x85 20x130 20x200	-	C53 - C54

Sikla Injection System VMU plus for masonry

Intended Use
Brick types and properties

Annex B5

Table B2: Installation parameters for autoclaved aerated concrete AAC and solid masonry (without sleeve) for pre- or through-setting installation

Threaded rod			M8	M10 IG-M6	M12 IG-M8	M16 IG-M10
Nominal drill hole diameter	d_0	[mm]	10	12	14	18
Depth of drill hole	h_0	[mm]	$h_{ef} + t_{fix}^{1)}$			
Effective anchorage depth	h_{ef}	[mm]	80	≥ 90	≥ 100	≥ 100
Diameter of clearance hole in the fixture	pre-setting installation	$d_f \leq$	9	7 (IG-M6) 12 (M10)	9 (IG-M8) 14 (M12)	12 (IG-M10) 18 (M16)
	through-setting installation	$d_f \leq$	12	14	16	20
Brush		[-]	RB 10	RB 12	RB 14	RB 18
Minimum brush diameter	d_b	[mm]	10,5	12,5	14,5	18,5
Maximum installation torque	T_{inst}	[Nm]	see Annex C			
Minimum member thickness	h_{min}	[mm]	$h_{ef} + 30$			
Minimum spacing	s_{min}	[mm]	see Annex C			
Minimum edge distance	c_{min}	[mm]	see Annex C			

¹⁾ Consider t_{fix} in case of through-setting installation

Table B3: Installation parameters in solid and hollow masonry (with sleeve) for pre-setting Installation

Threaded rod			M8	M8 / M10 IG-M6			M12 / M16 IG-M8 / IG-M10		
Sleeve VM-SH			12x80	16x85	16x130	16x130 /330	20x85	20x130	20x200
Nominal drill hole diameter	d_0	[mm]	12	16			20		
Depth of drill hole	h_0	[mm]	85	90	135	330	90	135	205
Effective anchorage depth	h_{ef}	[mm]	80	85	130	130	85	130	200
Diameter of clearance hole in the fixture	$d_f \leq$	[mm]	9	7 (IG-M6) 9 (M8) 12 (M10)			9 (IG-M8) 12 (IG-M10) 14 (M12) 18 (M16)		
Brush		[-]	RB 12	RB 16			RB 20		
Minimum brush diameter	d_b	[mm]	12,5	16,5			20,5		
Maximum installation torque	T_{inst}	[Nm]	see Annex C						
Minimum member thickness	h_{min}	[mm]	115	115	195	195	115	195	240
Minimum spacing	s_{min}	[mm]	see Annex C						
Minimum edge distance	c_{min}	[mm]	see Annex C						

Sikla Injection System VMU plus for masonry

Intended Use
Installation parameters

Annex B6

Table B4: Installation parameters in solid and hollow masonry (with sleeve) for pre-setting installation through non-load-bearing layers and/or through-setting installation

Threaded rod		M8 / M10 IG-M6		M12 / M16 IG-M8 / IG-M10	
Sleeve VM-SH		16x130	16x130/330	20x130	20x200
Nominal drill hole diameter	d_0 [mm]	16		20	
Depth of drill hole	h_0 [mm]	$h_{ef} + 5\text{mm} + t_{nll} + t_{fix}^{1)}$			
Effective anchorage depth	pre-setting installation h_{ef} [mm]	130	130	130	200
	through-setting installation h_{ef} [mm]	85	130	85	85
Maximum thickness of non-loadbearing layer	$\text{max. } t_{nll}$ [mm]	45	200	45	115
Diameter of clearance hole in the fixture	pre-setting installation $d_f \leq$ [mm]	7 (IG-M6) 9 (M8) 12 (M10)		9 (IG-M8) 12 (IG-M10) 14 (M12) 18 (M16)	
	through-setting installation $d_f \leq$ [mm]	18		22	
Brush	[-]	RB 16		RB 20	
Minimum brush diameter	d_b [mm]	16,5		20,5	
Maximum installation torque	T_{inst} [Nm]	see Annex C			
Minimum member thickness	h_{min} [mm]	195 (115)	195	195 (115)	240 (115)
Minimum spacing	s_{min} [mm]	see Annex C			
Minimum edge distance	c_{min} [mm]	see Annex C			

¹⁾ Consider t_{nll} and/or t_{fix} in case of non-loadbearing layers and/or through-setting installation.

Cleaning and installation tools

Compressed air tool (min. 6 bar)



Blow out pump (Volume ≥ 750 ml)



Brush RB



Brush extension



Sikla Injection System VMU plus for masonry

Intended use

Installation parameters and cleaning and installation tools

Annex B7

Table B5: Working and curing time - VMU plus

Temperature in the base material [°C]	Maximum working time	Minimum curing time in	
		in dry base material	in wet base material
- 10°C to - 6°C	90 min	24 h	48 h
- 5°C to - 1°C	90 min	14 h	28 h
0°C to + 4°C	45 min	7 h	14 h
+ 5°C to + 9°C	25 min	2 h	4 h
+ 10°C to + 19°C	15 min	80 min	160 min
+ 20°C to + 29°C	6 min	45 min	90 min
+ 30°C to + 34°C	4 min	25 min	50 min
+ 35°C to + 39°C	2 min	20 min	40 min
+ 40°C	1,5 min	15 min	30 min
Cartridge temperature ¹⁾	+5°C to +40°C		

¹⁾ At temperatures in the base material of -10°C to -6°C, the cartridge temperature must be at least +15°C.

Table B6: Working and curing time - VMU plus Polar









Temperature in the base material [°C]	Maximum working time	Minimum curing time	
		in dry base material	in dry base material
- 20°C to - 16°C	75 min	24 h	48 h
- 15°C to - 11°C	55 min	16 h	32 h
- 10°C to - 6°C	35 min	10 h	20 h
- 5°C to - 1°C	20 min	5 h	10 h
0°C to +4°C	10 min	2,5 h	5 h
+5°C to +9°C	6 min	80 min	160 min
+ 10°C	6 min	60 min	2 h
Cartridge temperature	-20°C to +10°C		

Sikla Injection System VMU plus for masonry

Intended use
Working and curing times

Annex B8

Installation instructions

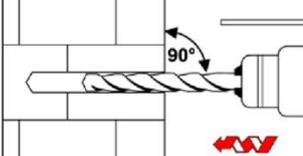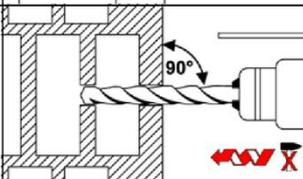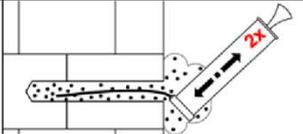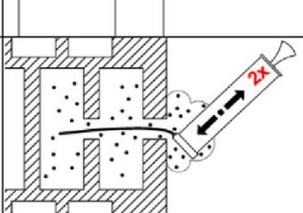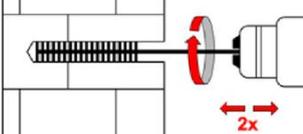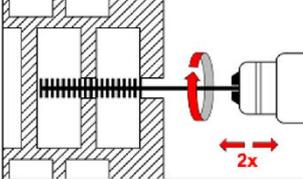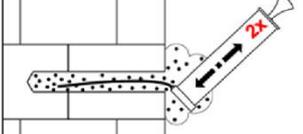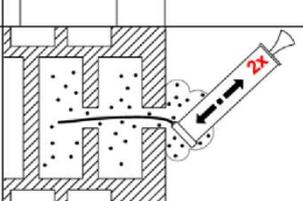Drilling of the drill hole in solid masonry and hollow masonry			
1	solid masonry		<p>Drill the hole perpendicular to the surface of the base material using the drilling method according to Annex C, with the specified drill hole diameter and depth of drill hole corresponding to the anchor size and anchorage depth of the selected anchor.</p> <p>In case of aborted drill hole, the drill hole shall be filled with mortar.</p>
	hollow masonry		
Cleaning in solid masonry and hollow masonry			
2a	solid masonry		<p>Blow out from the bottom of the bore hole with the blow out pump (Annex B7) a minimum of two times.</p> <p>For applications in solid masonry with a bore hole depth $h_0 > 100\text{mm}$ cleaning with compressed air is required.</p>
	hollow masonry		
2b	solid masonry		<p>Brush the hole with an appropriately sized wire brush $\geq d_{b,\text{min}}$ (Table B2, B3 and B4, check minimum brush diameter $d_{b,\text{min}}$) a minimum of two times using a drilling machine or battery screwdriver.</p> <p>If the drill hole ground is not reached, an appropriate brush extension must be used.</p>
	hollow masonry		
2c	solid masonry		<p>Finally starting from the bottom or back of the drill hole blow out the hole with the blow out pump again a minimum of two times.</p> <p>For applications in solid masonry with a bore hole depth $h_0 > 100\text{mm}$ cleaning with compressed air is required.</p>
	hollow masonry		









Sikla Injection System VMU plus for masonry

Intended use

Installation instruction: drilling of drill hole / cleaning in solid and hollow masonry

Annex B9

Installation instructions - continuation

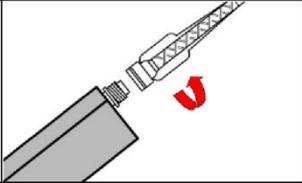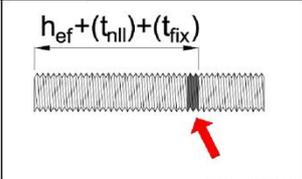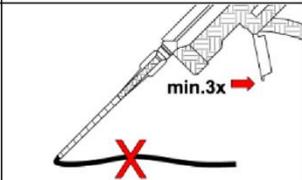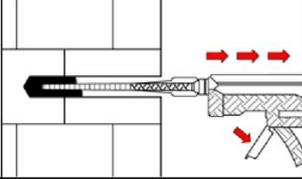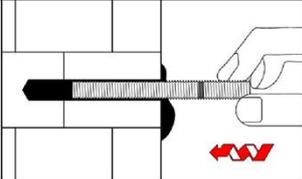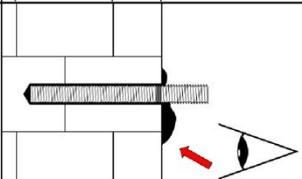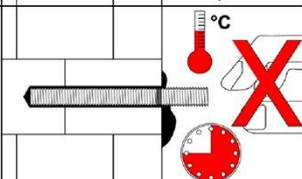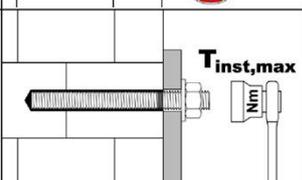Preparation injection		
3		Remove the cap and attach the supplied static-mixing nozzle to the cartridge and load the cartridge into the correct dispensing tool. In case of a foil tube cartridge, cut off the clip before use. For every working interruption longer than the recommended working time (Table B5 and B6) as well as for new cartridges, a new static-mixer shall be used.
4		Mark position of embedment depth on the threaded rod. Consider t_{nll} and/or t_{fix} in case of installation through non-loadbearing layers and/or through setting installation. The threaded rod shall be free of dirt, grease, oil or other foreign material.
5		Prior to dispensing into the drill hole, squeeze out separately (a minimum of three full strokes, for foil tube cartridges at least 6 full strokes) and discard non-uniformly mixed adhesive components until the mortar shows a consistent grey color.
Installation without sleeve		
6		Starting at the bottom of the drill hole and fill the hole up to approximately two-thirds with adhesive. Slowly withdraw the static mixing nozzle as the hole fills to avoid air pockets. Use mixer extension if necessary. Observe temperature dependent working time (Table B5 or B6).
7		Insert fastener while turning slightly up to the embedment mark.
8		Annular gap between threaded rod and base material must be completely filled with mortar. For through setting installation the annular gap between threaded rod and fixture must also be filled with mortar. Otherwise, the installation must be repeated starting from step 6 before the maximum working time has expired.
9		Allow the adhesive to cure to the specified time prior to applying any load or torque. Do not move or load the anchor until it is fully cured (Table B5 or B6). After full curing time remove excess mortar.
10		Install the fixture using a torque wrench, observing the maximum installation torque T_{inst} according to Annex C.

Sikla Injection System VMU plus for masonry

Intended use

Installation instruction: Preparation injection / Installation without sleeve

Annex B10

Installation instructions - continuation

Installation with sleeve		
6		Insert the perforated sleeve flush with the surface of the masonry. Only use sleeves that have the right length. Never cut the sleeve in the anchoring area. For through-setting installation with perforated sleeve VM SH 16x130/330 through a non-load-bearing layer and/or add-on part, the clamping area may be shortened to the thickness of the non-load-bearing layer and/or attachment.
7		Fill the perforated sleeve with mortar from the bottom or back. Use mixer extension if necessary. Refer to the cartridge label or the installation instructions for the exact quantity of mortar. For through setting installation, the perforated sleeve must be completely filled with mortar up to the fixture. Observe the working and curing times given in Table B5 and B6.
8		To optimize the distribution of the mortar, insert the fastener with slight rotation to the defined embedment depth.
9		Allow the adhesive to cure to the specified time prior to applying any load or torque. Do not move or load the anchor until it is fully cured (Table B5 and B6).
10		Install the fixture using a torque wrench, observing the maximum installation torque T_{inst} according to Annex C.

Sikla Injection System VMU plus for masonry

Intended use
Installation instruction: Installation with sleeve

Annex B11

Table C1: β - factor for job-site testing under tension loading

Brick type	Anchor size	Perfo sleeve VM-SH	anchorage depth h_{ef}	β -factor					
				$T_a:$ 24°C / 40°C		$T_b:$ 50°C / 80°C		$T_c:$ 72°C/120°C	
				d/d	w/d w/w	d/d	w/d w/w	d/d	w/d w/w
Autoclaved aerated concrete	all sizes	with or without VM-SH	all	0,95	0,86	0,81	0,73	0,81	0,73
Calcium silica bricks	$d_0 \leq 14$ mm	VM-SH	all	0,93	0,80	0,87	0,74	0,65	0,56
	$d_0 \geq 16$ mm			0,93	0,93	0,87	0,87	0,65	0,65
	$d_0 \leq 14$ mm	-	≤ 100 mm	0,93	0,80	0,87	0,74	0,65	0,56
	$d_0 \geq 16$ mm			0,93	0,93	0,87	0,87	0,65	0,65
	all sizes		> 100 mm	0,93	0,56	0,87	0,52	0,65	0,40
Clay bricks	all sizes	VM-SH	all	0,86	0,86	0,86	0,86	0,73	0,73
		-	≤ 100 mm	0,86	0,86	0,86	0,86	0,73	0,73
			> 100 mm	0,86	0,43	0,86	0,43	0,73	0,37
Concrete bricks	$d_0 \leq 12$ mm	with or without VM-SH	all	0,93	0,80	0,87	0,74	0,65	0,56
	$d_0 \geq 16$ mm			0,93	0,93	0,87	0,87	0,65	0,65

Sikla Injection System VMU plus for masonry

Performances
 β -factors for job site testing under tension load

Annex C1

Table C2: Characteristic steel resistance under tension and shear load for threaded rods

Threaded rod				M 8	M 10	M 12	M 16
Steel failure							
Cross sectional area A_s [mm ²]				36,6	58,0	84,3	157
Characteristic resistance under tension load ¹⁾							
steel, zinc plated	Property class 4.6 and 4.8	$N_{Rk,s}$	[kN]	15 (13) ¹⁾	23 (21) ¹⁾	34	63
	Property class 5.6 and 5.8	$N_{Rk,s}$	[kN]	18 (17) ¹⁾	29 (27) ¹⁾	42	79
	Property class 8.8	$N_{Rk,s}$	[kN]	29 (27) ¹⁾	46 (43) ¹⁾	67	126
stainless steel	Property class 50 (A2/A4/HCR)	$N_{Rk,s}$	[kN]	18	29	42	79
	Property class 70 (A2/A4/HCR)	$N_{Rk,s}$	[kN]	26	41	59	110
	Property class 80 (A4/HCR)	$N_{Rk,s}$	[kN]	29	46	67	126
Partial factors ²⁾							
steel, zinc plated	Property class 4.6 and 5.6	$\gamma_{Ms,N}$	[-]	2,0			
	Property class 4.8, 5.8 and 8.8	$\gamma_{Ms,N}$	[-]	1,5			
stainless steel	Property class 50 (A2/A4/HCR)	$\gamma_{Ms,N}$	[-]	2,86			
	Property class 70 (A2/A4/HCR)	$\gamma_{Ms,N}$	[-]	1,87 (1,5) ³⁾			
	Property class 80 (A4/HCR)	$\gamma_{Ms,N}$	[-]	1,6 (1,5) ³⁾			
Characteristic resistance under shear load ¹⁾							
Steel failure <u>without</u> lever arm							
steel, zinc plated	Property class 4.6 and 4.8	$V_{Rk,s}^0$	[kN]	7 (6) ¹⁾	12 (10) ¹⁾	17	31
	Property class 5.6 and 5.8	$V_{Rk,s}^0$	[kN]	9 (8) ¹⁾	15 (13) ¹⁾	21	39
	Property class 8.8	$V_{Rk,s}^0$	[kN]	15 (13) ¹⁾	23 (21) ¹⁾	34	63
stainless steel	Property class 50 (A2/A4/HCR)	$V_{Rk,s}^0$	[kN]	9	15	21	39
	Property class 70 (A2/A4/HCR)	$V_{Rk,s}^0$	[kN]	13	20	30	55
	Property class 80 (A4/HCR)	$V_{Rk,s}^0$	[kN]	15	23	34	63
Steel failure <u>with</u> lever arm – characteristic bending moment							
steel, zinc plated	Property class 4.6 and 4.8	$M_{Rk,s}^0$	[Nm]	15 (13) ¹⁾	30 (27) ¹⁾	52	133
	Property class 5.6 and 5.8	$M_{Rk,s}^0$	[Nm]	19 (16) ¹⁾	37 (33) ¹⁾	65	166
	Property class 8.8	$M_{Rk,s}^0$	[Nm]	30 (26) ¹⁾	60 (53) ¹⁾	105	266
stainless steel	Property class 50 (A2/A4/HCR)	$M_{Rk,s}^0$	[Nm]	19	37	65	166
	Property class 70 (A2/A4/HCR)	$M_{Rk,s}^0$	[Nm]	26	52	92	233
	Property class 80 (A4/HCR)	$M_{Rk,s}^0$	[Nm]	30	60	105	266
Partial factors ²⁾							
steel, zinc plated	Property class 4.6 and 5.6	$\gamma_{Ms,V}$	[-]	1,67			
	Property class 4.8, 5.8 and 8.8	$\gamma_{Ms,V}$	[-]	1,25			
stainless steel	Property class 50 (A2/A4/HCR)	$\gamma_{Ms,V}$	[-]	2,38			
	Property class 70 (A2/A4/HCR)	$\gamma_{Ms,V}$	[-]	1,56 (1,25) ³⁾			
	Property class 80 (A4/HCR)	$\gamma_{Ms,V}$	[-]	1,33 (1,25) ³⁾			

¹⁾ The characteristic resistances apply for all anchor rods with the cross-sectional area A_s specified here: VMU-A, V-A, VM-A. For commercial standard threaded rods with a smaller cross-sectional area (e.g. hot-dip galvanized threaded rods M8, M10 according to EN ISO 10684:2004 + AC:2009), the value in bracket is valid.

²⁾ In absence of national regulation

³⁾ Value in bracket only valid for anchor rod VMU-A or V-A

Sikla Injection System VMU plus for masonry

Performances
Characteristic steel resistance under tension and shear load for **threaded rods**

Annex C2

Table C3: Characteristic steel resistance under tension and shear load for internally threaded anchor rod

Internally threaded anchor rod				IG-M6	IG-M8	IG-M10
Steel failure ¹⁾						
Characteristic resistance under tension load						
steel, zinc plated	Property class 5.8	$N_{Rk,s}$	[kN]	10	17	29
	Property class 8.8	$N_{Rk,s}$	[kN]	16	27	46
stainless steel	Property class 70 (A4/HCR)	$N_{Rk,s}$	[kN]	14	26	41
Partial factors ²⁾						
steel, zinc plated	Property class 5.8	$\gamma_{Ms,N}$	[-]	1,5		
	Property class 8.8	$\gamma_{Ms,N}$	[-]	1,5		
stainless steel	Property class 70 (A4/HCR)	$\gamma_{Ms,N}$	[-]	1,87		
Characteristic resistance under shear load						
Steel failure <u>without</u> lever arm						
steel, zinc plated	Property class 5.8	$V^0_{Rk,s}$	[kN]	5	9	15
	Property class 8.8	$V^0_{Rk,s}$	[kN]	8	14	23
stainless steel	Property class 70 (A4/HCR)	$V^0_{Rk,s}$	[kN]	7	13	20
Steel failure <u>with</u> lever arm – characteristic bending moment						
steel, zinc plated	Property class 5.8	$M^0_{Rk,s}$	[Nm]	8	19	37
	Property class 8.8	$M^0_{Rk,s}$	[Nm]	12	30	60
stainless steel	Property class 70 (A4/HCR)	$M^0_{Rk,s}$	[Nm]	11	26	52
Partial factors ²⁾						
steel, zinc plated	Property class 5.8	$\gamma_{Ms,V}$	[-]	1,25		
	Property class 8.8	$\gamma_{Ms,V}$	[-]	1,25		
stainless steel	Property class 70 (A4/HCR)	$\gamma_{Ms,V}$	[-]	1,56		

¹⁾ Fastening screws or threaded rods (incl. nut and washer) must comply with the appropriate material and property class of the internally threaded anchor rod. The characteristic tension resistance for steel failure of the given strength class are valid for the internally threaded anchor rod and the fastening element.

²⁾ In absence of national regulation

Sikla Injection System VMU plus for masonry

Performances

Characteristic steel resistance under tension and shear load for **internally threaded anchor rod**

Annex C3

Table C4: Characteristic steel resistance under fire exposure - Threaded rod

Threaded rod				M 8	M 10	M 12	M 16
Characteristic resistance under tension load							
Steel, property class 5.8 and 8.8; Stainless steel (A2/ A4/ HCR) property class ≥ 50	R30	$N_{RK,s,fi}$	[kN]	1,1	1,7	3,0	5,7
	R60	$N_{RK,s,fi}$	[kN]	0,9	1,4	2,3	4,2
	R90	$N_{RK,s,fi}$	[kN]	0,7	1,0	1,6	3,0
	R120	$N_{RK,s,fi}$	[kN]	0,5	0,8	1,2	2,2
Characteristic resistance under shear load ¹⁾							
Steel failure <u>without</u> lever arm							
Steel, property class 5.8 and 8.8; Stainless steel (A2/ A4/ HCR) property class ≥ 50	R30	$V^0_{RK,s,fi}$	[kN]	1,1	1,7	3,0	5,7
	R60	$V^0_{RK,s,fi}$	[kN]	0,9	1,4	2,3	4,2
	R90	$V^0_{RK,s,fi}$	[kN]	0,7	1,0	1,6	3,0
	R120	$V^0_{RK,s,fi}$	[kN]	0,5	0,8	1,2	2,2
Steel failure <u>with</u> lever arm – characteristic bending moment							
Steel, property class 5.8 and 8.8; Stainless steel (A2/ A4/ HCR) property class ≥ 50	R30	$M^0_{RK,s,fi}$	[Nm]	1,1	2,2	4,7	12,0
	R60	$M^0_{RK,s,fi}$	[Nm]	0,9	1,8	3,5	9,0
	R90	$M^0_{RK,s,fi}$	[Nm]	0,7	1,3	2,5	6,3
	R120	$M^0_{RK,s,fi}$	[Nm]	0,5	1,0	1,8	4,7
Partial factor	all	$\gamma_{Ms,fi}$	[-]	1,0			

Table C5: Characteristic steel resistance under fire exposure - Internally threaded anchor rod

Internally threaded anchor rod				IG-M6	IG-M8	IG-M10
Characteristic resistance under tension load						
Steel, property class 5.8 and 8.8; Stainless steel (A4 / HCR) property class 70	R30	$N_{RK,s,fi}$	[kN]	0,3	1,1	1,7
	R60	$N_{RK,s,fi}$	[kN]	0,2	0,9	1,4
	R90	$N_{RK,s,fi}$	[kN]	0,2	0,7	1,0
	R120	$N_{RK,s,fi}$	[kN]	0,1	0,5	0,8
Characteristic resistance under shear load						
Steel failure <u>without</u> lever arm						
Steel, property class 5.8 and 8.8; Stainless steel (A4 / HCR) property class 70	R30	$V^0_{RK,s,fi}$	[kN]	0,3	1,1	1,7
	R60	$V^0_{RK,s,fi}$	[kN]	0,2	0,9	1,4
	R90	$V^0_{RK,s,fi}$	[kN]	0,2	0,7	1,0
	R120	$V^0_{RK,s,fi}$	[kN]	0,1	0,5	0,8
Steel failure <u>with</u> lever arm – characteristic bending moment						
Steel, property class 5.8 and 8.8; Stainless steel (A4 / HCR) property class 70	R30	$M^0_{RK,s,fi}$	[Nm]	0,2	1,1	2,2
	R60	$M^0_{RK,s,fi}$	[Nm]	0,2	0,9	1,8
	R90	$M^0_{RK,s,fi}$	[Nm]	0,1	0,7	1,3
	R120	$M^0_{RK,s,fi}$	[Nm]	0,1	0,5	1,0
Partial factor	all	$\gamma_{Ms,fi}$	[-]	1,0		


Sikla Injection System VMU plus for masonry

Performance
Characteristic steel resistance under fire exposure

Annex C4

Edge distance and spacing

- C_{cr} = Characteristic edge distance
- C_{min} = Minimum edge distance
- $C_{cr,fi}$ = Characteristic edge distance under fire exposure
- $S_{cr,II}$ = Characteristic (minimum) spacing for anchor placed parallel to horizontal joint
($S_{min,II}$)
- $S_{cr,I}$ = Characteristic (minimum) spacing for anchor placed perpendicular to horizontal joint
($S_{min,I}$)
- $S_{cr,fi,II}$ = Characteristic spacing for anchor placed perpendicular to horizontal joint (perpendicular) joint
($S_{cr,fi,I}$)

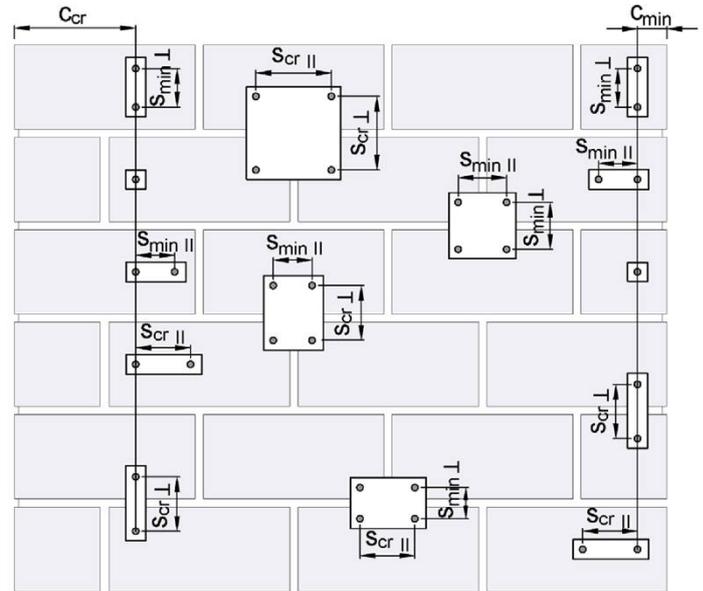

Definition of reduction- and group factors

Anchor position	Load direction		
	Tension load	Shear load parallel to free edge V_{II}	Shear load perpendicular to free edge V_{\perp}
Anchors parallel to horizontal joint $S_{cr,II}$ ($S_{min,II}$)			
Anchors vertical to horizontal joint $S_{cr,I}$ ($S_{min,I}$)			

- $\alpha_{edge,N}$ = Reduction factor for tension loads at the free edge (single anchor) (for $C_{min} \leq c < C_{cr}$)
- $\alpha_{edge,V_{\perp}}$ = Reduction factor for shear loads perpendicular to the free edge (single anchor) (for $C_{min} \leq c < C_{cr}$)
- $\alpha_{edge,V_{II}}$ = Reduction factor for shear loads parallel to the free edge (single anchor) (for $C_{min} \leq c < C_{cr}$)
- $\alpha_{g,II,N}$ = Group factor for anchors parallel to horizontal joint under tension load
- $\alpha_{g,I,N}$ = Group factor for anchors perpendicular to horizontal joint under tension load
- $\alpha_{g,II,V_{II}}$ = Group factor for anchors parallel to horizontal joint under shear load parallel to the free edge
- $\alpha_{g,I,V_{II}}$ = Group factor for anchors perpendicular to horizontal joint under shear load parallel to the free edge
- $\alpha_{g,II,V_{\perp}}$ = Group factor for anchors parallel to horizontal joint under shear load perpendicular to the free edge
- $\alpha_{g,I,V_{\perp}}$ = Group factor for anchors perpendicular to hor. joint under shear load perpendicular to the free edge

Single anchor at the edge:	$N_{RK,b,c} = \alpha_{edge,N} * N_{RK,b}$	resp.	$N_{RK,p,c} = \alpha_{edge,N} * N_{RK,p}$
	$V_{RK,c,II} = \alpha_{edge,V_{II}} * V_{RK,b}$		
	$V_{RK,c,\perp} = \alpha_{edge,V_{\perp}} * V_{RK,b}$		
Group of 2 anchors:	$N^{g_{RK}} = \alpha_{g,N} * N_{RK,b}$		
	$V^{g_{RK,II}} = \alpha_{g,V_{II}} * V_{RK,b}$	resp.	$V^{g_{RK,\perp}} = \alpha_{g,V_{\perp}} * V_{RK,b}$ (for $c \geq C_{cr}$)
	$V^{g_{RK,c,II}} = \alpha_{g,V_{II}} * V_{RK,b}$	resp.	$V^{g_{RK,c,\perp}} = \alpha_{g,V_{\perp}} * V_{RK,b}$ (for $c \geq C_{min}$)
Group of 4 anchors:	$N^{g_{RK}} = \alpha_{g,II,N} * \alpha_{g,I,N} * N_{RK,b}$		
	$V^{g_{RK,II}} = \alpha_{g,II,V_{II}} * \alpha_{g,I,V_{II}} * V_{RK,b}$	resp.	$V^{g_{RK,\perp}} = \alpha_{g,II,V_{\perp}} * \alpha_{g,I,V_{\perp}} * V_{RK,b}$ (for $c \geq C_{cr}$)
	$V^{g_{RK,c,II}} = \alpha_{g,II,V_{II}} * \alpha_{g,I,V_{II}} * V_{RK,b}$	resp.	$V^{g_{RK,c,\perp}} = \alpha_{g,II,V_{\perp}} * \alpha_{g,I,V_{\perp}} * V_{RK,b}$ (for $c \geq C_{min}$)

Equations depend on anchor position and load direction (see table above). Reduction factor, group factor and resistances see Annex C. Reduction for installation in joints see Annex B1.

Sikla Injection System VMU plus for masonry

Performance
Definition of spacing and edge distance and reduction- and group factors α

Annex C5

Brick type: Autoclaved aerated concrete AAC

Table C6: Description

Brick type	Autoclaved aerated concrete AAC	
Density	ρ [kg/dm ³]	0,35 – 0,6
Normalised mean compressive strength	$f_b \geq$ [N/mm ²]	2, 4 or 6
Norm	[-]	EN 771-4:2011+A1:2015
Producer (country code)	[-]	e.g. Porit (DE)
Brick dimensions	[mm]	$\geq 499 \times 240 \times 249$
Drilling method	[-]	Rotary drilling



Table C7: Installation parameter

Anchor size		M8	M10	M12	M16	IG-M6	IG-M8	IG-M10
Installation torque	T_{inst} [Nm]	≤ 5	≤ 5	≤ 10	≤ 10	≤ 5	≤ 5	≤ 10
Edge distance	c_{cr} [mm]	150 (for shear loads perpendicular to the free edge: $c_{cr} = 210$)						
Minimum edge distance	c_{min} [mm]	50						
Spacing	$s_{cr, II}$ [mm]	300						
	$s_{cr, \perp}$ [mm]	250						
Minimum spacing	$s_{min, II}$ [mm]	50						
	$s_{min, \perp}$ [mm]							

Table C8: Reduction factors for single anchors at the edge









Tension load			Shear load					
			perpendicular to the free edge			parallel to the free edge		
with $c \geq$	$\alpha_{edge, N}$		with $c \geq$	$\alpha_{edge, \perp L}$		with $c \geq$	$\alpha_{edge, \parallel II}$	
50	0,85		50	0,12		50	0,70	
150	1,00		125	0,50		125	0,85	
			210	1,00		150	1,00	

Table C9: Factors for anchor groups

	Position parallel to horizontal joint				Position perpendicular to horizontal joint			
Tension load		with $c \geq$	with $s \geq$	$\alpha_{g II, N}$		with $c \geq$	with $s \geq$	$\alpha_{g \perp, N}$
		50	50	1,10		50	50	0,75
		150	50	1,25		150	50	0,90
		150,56	300	2,00		150	250	2,00
Shear load perpendicular to the free edge		with $c \geq$	with $s \geq$	$\alpha_{g II, \perp L}$		with $c \geq$	with $s \geq$	$\alpha_{g \perp, \perp L}$
		50	50	0,20		50	50	0,25
		210	50	1,60		210	50	1,80
		210	300	2,00		210	250	2,00
Shear load parallel to the free edge		With $c \geq$	with $s \geq$	$\alpha_{g II, \parallel II}$		with $c \geq$	with $s \geq$	$\alpha_{g \perp, \parallel II}$
		50	50	1,15		50	50	0,80
		150	50	1,60		150	50	1,10
		150	300	2,00		150	250	2,00

Sikla Injection System VMU plus for masonry

Performances - Autoclaved aerated concrete AAC
Description, installation parameters, reduction- and group factors

Annex C6

Brick type: Autoclaved aerated concrete AAC - continuation

Table C10: Characteristic resistance under tension and shear load

Anchor size	Perforated Sleeve	Effective anchorage depth	Characteristic resistance with $c \geq c_{cr}$ and $s \geq s_{cr}$						
			Use condition						
			d/d			w/d w/w			d/d w/d w/w
			24°C / 40°C	50°C / 80°C	72°C / 120°C	24°C / 40°C	50°C / 80°C	72°C / 120°C	all temperature ranges
h_{ef}		$N_{Rk,b} = N_{Rk,p}^{1)}$					$V_{Rk,b}^{1)}$		
[mm]		[kN]					[kN]		
Normalised mean compressive strength $f_b \geq 2 \text{ N/mm}^2$			Density $\rho \geq 0,35 \text{ kg/dm}^3$						
M8	-	80	1,2	0,9	0,9	0,9	0,9	0,9	1,5
M10 / IG-M6	-	90	1,2	0,9	0,9	0,9	0,9	0,9	2,5
M12 / M16 IG-M8 / IG-M10	-	100	2,0	1,5	1,5	1,5	1,5	1,5	2,5
M8	VM-SH 12	80	1,2	0,9	0,9	0,9	0,9	0,9	1,5
M8 / M10 IG-M6	VM-SH 16	≥ 85	1,2	0,9	0,9	0,9	0,9	0,9	2,5
M12 / M16 IG-M8 / IG-M10	VM-SH 20	≥ 85	2,0	1,5	1,5	1,5	1,5	1,5	2,5
Normalised mean compressive strength $f_b \geq 4 \text{ N/mm}^2$			Density $\rho \geq 0,50 \text{ kg/dm}^3$						
M8	-	80	3,0	2,5	2,0	2,5	2,0	2,0	4,5
M10 / IG-M6	-	90	3,0	2,5	2,0	2,5	2,0	2,0	7,5
M12 / M16 IG-M8 / IG-M10	-	100	5,0	4,5	4,0	4,5	4,0	4,0	7,5
M8	VM-SH 12	80	3,0	2,5	2,0	2,5	2,0	2,0	4,5
M8 / M10 IG-M6	VM-SH 16	≥ 85	3,0	2,5	2,0	2,5	2,0	2,0	7,5
M12 / M16 IG-M8 / IG-M10	VM-SH 20	≥ 85	5,0	4,5	4,0	4,5	4,0	4,0	7,5

¹⁾ $N_{Rk,b,c} = N_{Rk,p,c}$ and $V_{Rk,c,II} = V_{Rk,c,I}$ according to Annex C5

Sikla Injection System VMU plus for masonry

Performances - Autoclaved aerated concrete AAC
Characteristic resistance

Annex C7

Brick type: Autoclaved aerated concrete AAC - continuation

Characteristic resistance - continuation:

Anchor size	Sleeve	Effective anchorage depth	Characteristic resistance with $c \geq c_{cr}$ and $s \geq s_{cr}$						
			Use condition						
			d/d			w/d w/w			d/d w/d w/w
			24°C / 40°C	50°C / 80°C	72°C / 120°C	24°C / 40°C	50°C / 80°C	72°C / 120°C	all temperature ranges
h_{ef}	$N_{Rk,b} = N_{Rk,p}^{1)}$						$V_{Rk,b}^{1)}$		
[mm]	[kN]						[kN]		
Normalised mean compressive strength $f_b \geq 6 \text{ N/mm}^2$			Density $\rho \geq 0,60 \text{ kg/dm}^3$						
M8	-	80	4,0	3,5	3,0	3,5	3,0	3,0	6,0
M10 / IG-M6	-	90	4,0	3,5	3,0	3,5	3,0	3,0	10,0
M12 / M16 IG-M8 / IG-M10	-	100	7,0	6,0	5,5	6,5	5,5	5,5	10,0
M8	VM-SH 12	80	4,0	3,5	3,0	3,5	3,0	3,0	6,0
M8 / M10 IG-M6	VM-SH 16	≥ 85	4,0	3,5	3,0	3,5	3,0	3,0	10,0
M12 / M16 IG-M8 / IG-M10	VM-SH 20	≥ 85	7,0	6,0	5,5	6,5	5,5	5,5	10,0

¹⁾ $N_{Rk,b,c} = N_{Rk,p,c}$ and $V_{Rk,c II} = V_{Rk,c \perp}$ according to Annex C5

Table C11: Displacements

Anchor size	h_{ef}	δ_N / N	δ_{N0}	$\delta_{N\infty}$	δ_V / V	δ_{V0}	$\delta_{V\infty}$
	[mm]	[mm/kN]	[mm]	[mm]	[mm/kN]	[mm]	[mm]
M8 – M12 / IG-M6 – IG-M10	all	0,1	0,1*N _{Rk} / 2,8	2* δ_{N0}	0,3	0,3*V _{Rk} / 2,8	1,5* δ_{V0}
M16					0,1	0,1*V _{Rk} / 2,8	

Sikla Injection System VMU plus for masonry

Performances - Autoclaved aerated concrete AAC
Characteristic resistance and displacements

Annex C8

Brick type: Solid calcium silica brick KS-NF

Table C12: Description

Brick type	Solid calcium silica brick KS-NF	
Density	ρ [kg/dm ³]	$\geq 2,0$
Normalised mean compressive strength	f_b [N/mm ²]	≥ 28
Conversion factor for lower compressive strengths		$(f_b / 28)^{0,5} \leq 1,0$
Norm	[-]	EN 771-2: 2011+A1:2015
Producer (country code)	[-]	e.g. Wemding (DE)
Brick dimensions	[mm]	$\geq 240 \times 115 \times 71$
Drilling method	[-]	Hammer drilling

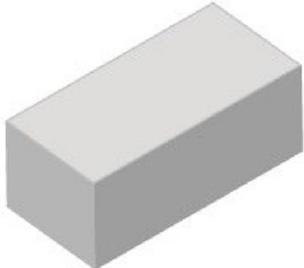





Table C13: Installation parameter







Anchor size		M8	M10	M12	M16	IG-M6	IG-M8	IG-M10
Installation torque	T_{inst} [Nm]	≤ 10	≤ 10	≤ 15	≤ 15	≤ 10	≤ 10	≤ 10
Edge distance (under fire exposure)	$c_{Cr}; (c_{Cr,fi})$ [mm]	150 (2 h_{ef}) (for shear loads perpendicular to the free edge: $c_{Cr} = 240$)						
Minimum Edge Distance	c_{min} [mm]	60						
Spacing (under fire exposure)	$s_{Cr,II}; (s_{Cr,fi,II})$ [mm]	240 (4 h_{ef})						
	$s_{Cr,I}; (s_{Cr,fi,I})$ [mm]	150 (4 h_{ef})						
Minimum Spacing	$s_{min,II}; s_{min,I}$ [mm]	75						

Table C14: Reduction factors for single anchors at the edge

Tension load			Shear load					
			perpendicular to the free edge			parallel to the free edge		
	with $c \geq$	$\alpha_{edge,N}$		with $c \geq$	$\alpha_{edge,V \perp}$		with $c \geq$	$\alpha_{edge,V \parallel}$
	60 ¹⁾	0,50		60	0,30		60	0,60
	100 ¹⁾	0,50		100	0,50		100	1,00
	150 ¹⁾	1,00		240	1,00		150	1,00
	180	1,00						

¹⁾ All applications, except for $h_{ef} = 200\text{mm}$ and without sleeve

Table C15: Factors for anchor groups

Position parallel to horizontal joint					Position perpendicular to horizontal joint				
Tension load		with $c \geq$	with $s \geq$	$\alpha_{g,II,N}$		with $c \geq$	with $s \geq$	$\alpha_{g \perp, N}$	
		60 ¹⁾	75	0,70		60 ¹⁾	75	1,15	
		150 ¹⁾	75	1,40		150 ¹⁾	75	2,00	
		150 ¹⁾	240	2,00		150 ¹⁾	150	2,00	
		180 ²⁾	75	1,00		180 ²⁾	75	1,15	
		180 ²⁾	240	1,70		180 ²⁾	150	2,00	
		240 ²⁾	240	2,00					
Shear load perpendicular to the free edge		with $c \geq$	with $s \geq$	$\alpha_{g,II,V \perp}$		with $c \geq$	with $s \geq$	$\alpha_{g \perp, V \perp}$	
		60	75	0,75		60	75	0,90	
		150	75	2,00		150	75	2,00	
		150	250	2,00		150	150	2,00	
Shear load parallel to the free edge		with $c \geq$	with $s \geq$	$\alpha_{g,II,V \parallel}$		with $c \geq$	with $s \geq$	$\alpha_{g \perp, V \parallel}$	
		60	75	2,00		60	75	2,00	
		150	75	2,00		150	75	2,00	
		150	250	2,00		150	150	2,00	

¹⁾ All applications, except for $h_{ef} = 200\text{mm}$ and without sleeve

²⁾ Only for application with $h_{ef} = 200\text{mm}$ and without sleeve

Sikla Injection System VMU plus for masonry

Performance - Solid calcium silica brick KS-NF
Description, installation parameters, reduction- and group factors

Annex C9

Brick type: Solid calcium silica brick KS-NF – continuation

Table C16: Characteristic resistance under tension and shear load

Anchor size	Sleeve	Effective anchorage depth	Characteristic resistance with $c \geq c_{cr}$ and $s \geq s_{cr}$						
			Use condition						
			d/d			w/d w/w			d/d w/d w/w
			24°C / 40°C	50°C / 80°C	72°C / 120°C	24°C / 40°C	50°C / 80°C	72°C / 120°C	all temperature ranges
h_{ef}	$N_{Rk,b} = N_{Rk,p}^{1)}$						$V_{Rk,b}^{1)}$		
[mm]	[kN]						[kN]		
Normalised mean compressive strength $f_b \geq 28 \text{ N/mm}^2$ ²⁾									
M8	-	80	7,0	6,5	5,0	6,0	5,5	4,0	7,0
M10 / IG-M6	-	≥ 90	7,0	6,5	5,0	6,0	5,5	4,0	
M12 / IG-M8	-	≥ 100	7,0	6,5	5,0	6,0	5,5	4,0	
M16 / IG-M10	-	≥ 100	7,0	6,5	5,0	7,0	6,5	5,0	
M10 - M16 IG-M6 - IG-M10	-	200	9,0	8,5	6,5	5,5	5,0	4,0	
M8	VM-SH 12	80	7,0	6,5	5,0	6,0	5,5	4,0	
M8 / M10/ IG-M6	VM-SH 16	≥ 85	7,0	6,5	5,0	7,0	6,5	5,0	
M12 / M16 IG-M8 / IG-M10	VM-SH 20	≥ 85	7,0	6,5	5,0	7,0	6,5	5,0	

¹⁾ $N_{Rk,b,c} = N_{Rk,p,c}$ and $V_{Rk,c,II} = V_{Rk,c,I}$ according to Annex C5

²⁾ For lower compressive strengths resistances must be multiplied by the conversion factor according to Table C12. For stones with higher strengths, the shown values are valid without conversion.

Table C17: Displacements

Anchor size	h_{ef}	δ_N / N	δ_{N0}	$\delta_{N\infty}$	δ_v / V	δ_{v0}	$\delta_{v\infty}$
	[mm]	[mm/kN]	[mm]	[mm]	[mm/kN]	[mm]	[mm]
M8 – M12 / IG-M6 – IG-M10	all	0,1	0,1 * $N_{Rk} / 3,5$	2 * δ_{N0}	0,3	0,3 * $V_{Rk} / 3,5$	1,5 * δ_{v0}
M16					0,1	0,1 * $V_{Rk} / 3,5$	

Table C18: Characteristic resistance under fire exposure

Anchor size	Sleeve	Effective anchorage depth	Characteristic resistance $N_{Rk,b,fi} = N_{Rk,p,fi} = V_{Rk,b,fi}$				
			h_{ef}	R30	R60	R90	R120
			[mm]	[kN]			
M8	-	80	0,48	0,41	0,34	0,30	
M10 / IG-M6	-	≥ 90					
M12 / IG-M8	-	≥ 100					
M16 / IG-M10	-	≥ 100					
M8	VM-SH 12	80	0,47	0,26	No performance assessed	No performance assessed	
M8 / M10 / IG-M6	VM-SH 16	≥ 85					
M12 / M16 IG-M8 / IG-M10	VM-SH 20	≥ 85					

Sikla Injection System VMU plus for masonry

Performance

Characteristic resistance, displacements, characteristic resistance under fire exposure

Annex C10

Brick type: Hollow calcium silica brick KSL-3DF

Table C19: Description

Brick type		Hollow calcium silica brick KSL-3DF
Density	ρ [kg/dm ³]	$\geq 1,4$
Normalised mean compressive strength	f_b [N/mm ²]	≥ 14
Conversion factor for lower compressive strengths		$(f_b / 14)^{0,75} \leq 1,0$
Norm	[-]	EN 771-2:2011+A1:2015
Producer (country code)	[-]	e.g. KS-Wemding (DE)
Brick dimensions	[mm]	$\geq 240 \times 175 \times 113$
Drilling method	[-]	Rotary drilling

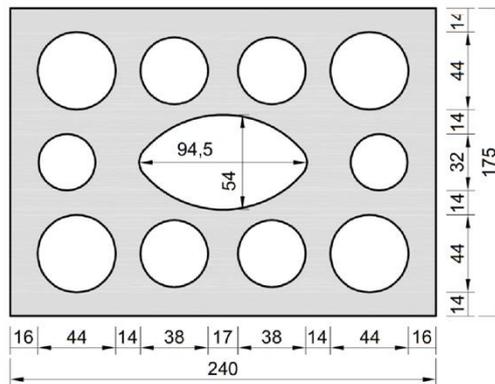



Table C20: Installation parameter

Anchor size		M8	M10	M12	M16	IG-M6	IG-M8	IG-M10
Installation torque	T_{inst} [Nm]	≤ 5	≤ 5	≤ 8	≤ 8	≤ 5	≤ 8	≤ 8
Edge distance	c_{cr} [mm]	120 (for shear loads perpendicular to the free edge: $c_{cr} = 240$)						
Minimum edge distance	c_{min} [mm]	60						
Spacing	$s_{cr, II}$ [mm]	240						
	$s_{cr, \perp}$ [mm]	120						
Minimum spacing	$s_{min, II}; s_{min, \perp}$ [mm]	120						

Table C21: Reduction factors for single anchors at the edge

Tension load			Shear load					
			perpendicular to the free edge			parallel to the free edge		
with $c \geq$	$\alpha_{edge, N}$		with $c \geq$	$\alpha_{edge, \perp L}$		with $c \geq$	$\alpha_{edge, \parallel II}$	
60	1,00		60	0,30		60	1,00	
120	1,00		240	1,00		120	1,00	

Sikla Injection System VMU plus for masonry

Performances - Hollow calcium silica brick KSL-3DF
Description, installation parameters, reduction factors

Annex C11

Brick type: Hollow calcium silica brick KSL-3DF – continuation

Table C22: Factors for anchor groups

	Position parallel to horizontal joint				Position perpendicular to horizontal joint			
Tension load		with $c \geq$	with $s \geq$	$\alpha_{g II, N}$		with $c \geq$	with $s \geq$	$\alpha_{g \perp, N}$
		60	120	1,50		60	120	1,00
		120	120	2,00		60	120	1,00
		120	240	2,00		120	120	2,00
Shear load perpendicular to the free edge		with $c \geq$	with $s \geq$	$\alpha_{g II, V \perp}$		with $c \geq$	with $s \geq$	$\alpha_{g \perp, V \perp}$
		60	120	0,30		60	120	0,30
		120	120	1,00		60	120	0,30
		120	240	2,00		240	120	2,00
Shear load parallel to the free edge		with $c \geq$	with $s \geq$	$\alpha_{g II, V \parallel}$		with $c \geq$	with $s \geq$	$\alpha_{g \perp, V \parallel}$
		60	120	1,00		60	120	1,00
		120	120	1,60		120	120	2,00
		120	240	2,00		120	120	2,00

Table C23: Characteristic resistance under tension and shear load

Anchor size	Sleeve	Effective anchorage depth	Characteristic resistance with $c \geq c_{Cr}$ and $s \geq s_{Cr}$						
			Use condition						
			d/d			w/d			d/d
			w/w			w/w			w/w
			24°C / 40°C	50°C / 80°C	72°C / 120°C	24°C / 40°C	50°C / 80°C	72°C / 120°C	all temperature ranges
		h_{ef}	$N_{Rk,b} = N_{Rk,p}^{1)}$						$V_{Rk,b}^{1)}$
		[mm]	[kN]						[kN]
Normalised mean compressive strength $f_b \geq 14 \text{ N/mm}^2$ ²⁾									
M8 / M10 IG-M6	VM-SH 16	≥ 85	2,5	2,5	1,5	2,5	2,5	1,5	6,0
		130	2,5	2,5	2,0	2,5	2,5	2,0	
M12 / M16 IG-M8 IG-M10	VM-SH 20	≥ 85	6,5	6,0	4,5	6,5	6,0	4,5	

¹⁾ $N_{Rk,b,c} = N_{Rk,p,c}$ and $V_{Rk,c II} = V_{Rk,c \perp}$ according to Annex C5

²⁾ For lower compressive strengths resistances must be multiplied by the conversion factor according to Table C19. For stones with higher strengths, the shown values are valid without conversion.

Table C24: Displacements

Anchor size	h_{ef}	δ_N / N	δ_{N0}	$\delta_{N\infty}$	δ_V / V	δ_{V0}	$\delta_{V\infty}$
	[mm]	[mm/kN]	[mm]	[mm]	[mm/kN]	[mm]	[mm]
M8 – M12 / IG-M6 – IG-M10	all	0,13	0,13* $N_{Rk} / 3,5$	2* δ_{N0}	0,55	0,55* $V_{Rk} / 3,5$	1,5* δ_{V0}
M16					0,31	0,31* $V_{Rk} / 3,5$	

Sikla Injection System VMU plus for masonry

Performance - Hollow calcium silica brick KSL-3DF
Group factors, characteristic resistances and displacements

Annex C12

Brick type: Hollow calcium silica brick KSL-8DF

Table C25: Description

Brick type		Hollow calcium silica brick KSL-8DF
Density	ρ [kg/dm ³]	$\geq 1,4$
Normalised mean compressive strength	f_b [N/mm ²]	≥ 12
Conversion factor for lower compressive strengths		$(f_b / 12)^{0,75} \leq 1,0$
Norm	[-]	EN 771-2:2011+A1:2015
Producer (country code)	[-]	e.g. KS-Wemding (DE)
Brick dimensions	[mm]	$\geq 248 \times 240 \times 238$
Drilling method	[-]	Rotary drilling

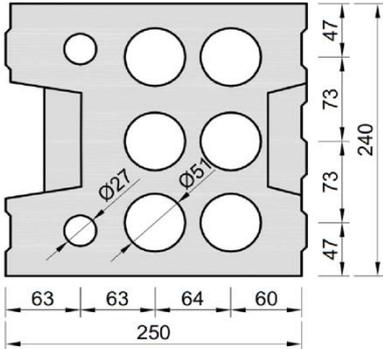






Table C26: Installation parameter

Anchor size		M8	M10	M12	M16	IG-M6	IG-M8	IG-M10
Installation torque	T_{inst} [Nm]	≤ 5	≤ 5	≤ 8	≤ 8	≤ 5	≤ 8	≤ 8
Edge distance	c_{cr} [mm]	120 (for shear loads perpendicular to the free edge: $c_{cr} = 250$)						
Minimum edge distance	c_{min} [mm]	50						
Spacing	$s_{cr, II}$ [mm]	250						
	$s_{cr, \perp}$ [mm]	120						
Minimum spacing	$s_{min, II}$ [mm]	50						
	$s_{min, \perp}$ [mm]							

Table C27: Reduction factors for single anchors at the edge

Tension load			Shear load					
			perpendicular to the free edge			perpendicular to the free edge		
with $c \geq$	$\alpha_{edge, N}$		with $c \geq$	$\alpha_{edge, V \perp}$		with $c \geq$	$\alpha_{edge, V \parallel}$	
50	1,00		50	0,30		50	1,00	
120	1,00		250	1,00		120	1,00	

Sikla Injection System VMU plus for masonry

Performances - Hollow calcium silica brick KSL-8DF
Description, installation parameters, reduction factors

Annex C13

Brick type: Hollow calcium silica brick KSL-8DF – continuation

Table C28: Factors for anchor groups

	Position parallel to horizontal joint			Position perpendicular to horizontal joint				
		with $c \geq$	with $s \geq$	$\alpha_{g II, N}$		with $c \geq$	with $s \geq$	$\alpha_{g \perp, N}$
Tension load		50	50	1,00		50	50	1,00
		120	250	2,00		120	120	2,00
Shear load perpendicular to the free edge		50	50	0,45		50	50	0,45
		250	50	1,15		250	50	1,20
		250	250	2,00		250	250	2,00
Shear load parallel to the free edge		50	50	1,30		50	50	1,00
		120	250	2,00		120	250	2,00

Table C29: Characteristic resistance under tension and shear load

Anchor size	Sleeve	Effective anchorage depth	Characteristic resistance with $c \geq c_{cr}$ and $s \geq s_{cr}$						
			Use condition						
			d/d			w/d w/w			d/d w/d w/w
			24°C / 40°C	50°C / 80°C	72°C / 120°C	24°C / 40°C	50°C / 80°C	72°C / 120°C	all temperature ranges
		h_{ef}	$N_{Rk,b} = N_{Rk,p}^{1)}$						$V_{Rk,b}^{1)}$
		[mm]	[kN]						[kN]
Normalised mean compressive strength $f_b \geq 12 \text{ N/mm}^2$ ²⁾									
M8 / M10 IG-M6	VM-SH 16	130	5,0	4,5	3,5	5,0	4,5	3,5	3,5
M12 / M16 IG-M8 IG-M10	VM-SH 20	≥ 130	5,0	4,5	3,5	5,0	4,5	3,5	6,0

¹⁾ $N_{Rk,b,c} = N_{Rk,p,c}$ and $V_{Rk,c II} = V_{Rk,c \perp}$ according to Annex C5

²⁾ For lower compressive strengths resistances must be multiplied by the conversion factor according to Table C25. For stones with higher strengths, the shown values are valid without conversion.

Table C30: Displacements

Anchor size	h_{ef}	δ_N / N	δ_{N0}	$\delta_{N\infty}$	δ_v / V	δ_{v0}	$\delta_{v\infty}$
	[mm]	[mm/kN]	[mm]	[mm]	[mm/kN]	[mm]	[mm]
M8 – M12 / IG-M6 – IG-M10	all	0,13	0,13* N_{Rk} / 3,5	2* δ_{N0}	0,55	0,55* V_{Rk} / 3,5	1,5* δ_{v0}
M16					0,31	0,31* V_{Rk} / 3,5	

Sikla Injection System VMU plus for masonry

Performances - Hollow calcium silica brick KSL-8DF
Group factors, characteristic resistances and displacements

Annex C14

Brick type: Hollow calcium silica brick KSL-12DF

Table C31: Description

Brick type		Hollow calcium silica brick KSL-12DF
Density	ρ [kg/dm ³]	$\geq 1,4$
Normalised mean compressive strength	f_b [N/mm ²]	≥ 12
Conversion factor for lower compressive strengths		$(f_b / 12)^{0,75} \leq 1,0$
Norm	[-]	EN 771-2:2011+A1:2015
Producer (country code)	[-]	e.g. KS-Wemding (DE)
Brick dimensions	[mm]	$\geq 498 \times 175 \times 238$
Drilling method	[-]	Rotary drilling

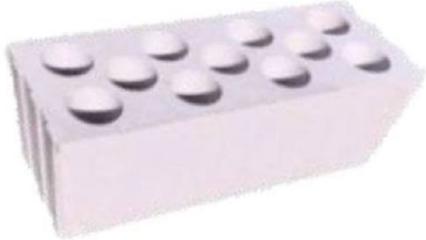
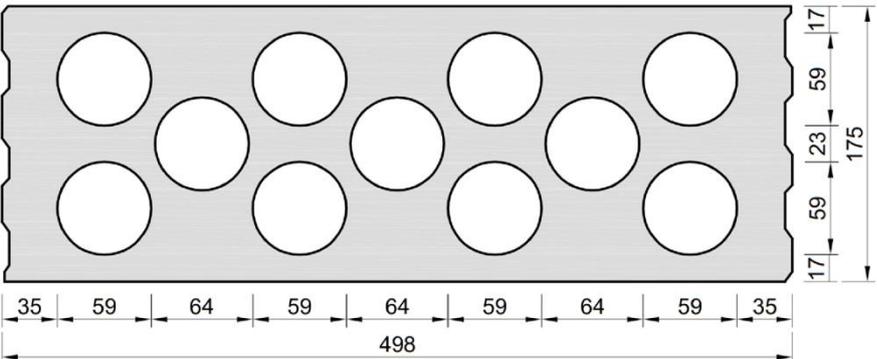




Table C32: Installation parameter

Anchor size		M8	M10	M12	M16	IG-M6	IG-M8	IG-M10
Installation torque	T_{inst} [Nm]	≤ 4	≤ 4	≤ 5	≤ 5	≤ 4	≤ 5	≤ 5
Edge distance (under fire exposure)	$c_{Cr}, (c_{Cr,fi})$ [mm]	120 (2 h_{ef}) (for shear loads perpendicular to the free edge: $c_{Cr} = 500$)						
Minimum edge distance	c_{min} [mm]	50						
Spacing (under fire exposure)	$s_{Cr,II}; (s_{Cr,fi,II})$ [mm]	500 (4 h_{ef})						
	$s_{Cr,I}; (s_{Cr,fi,I})$ [mm]	120 (4 h_{ef})						
Minimum spacing	$s_{min,II}; s_{min,I}$ [mm]	50						

Table C33: Reduction factors for single anchors at the edge

Tension load			Shear load			
			perpendicular to the free edge		parallel to the free edge	
with $c \geq$	$\alpha_{edge,N}$		with $c \geq$	$\alpha_{edge,V,L}$	with $c \geq$	$\alpha_{edge,V,II}$
50	1,00		50	0,45	50	1,00
120	1,00		500	1,00	120	1,00

Sikla Injection System VMU plus for masonry

Performance - - Hollow calcium silica brick KSL-12DF
Description, installation parameters, reduction factors

Annex C15

Brick type: Hollow calcium silica brick KSL-12DF – continuation

Table C34: Factors for anchor groups







	Position parallel to horizontal joint				Position perpendicular to horizontal joint			
		with $c \geq$	with $s \geq$	$\alpha_{g II, N}$		with $c \geq$	with $s \geq$	$\alpha_{g \perp, N}$
Tension load		50	50	1,50		50	50	1,00
		120	500	2,00		120	240	2,00
Shear load perpendicular to the free edge		with $c \geq$	with $s \geq$	$\alpha_{g II, V \perp}$		with $c \geq$	with $s \geq$	$\alpha_{g \perp, V \perp}$
		50	50	0,55		50	50	0,50
		500	50	1,00		500	50	1,00
		500	500	2,00		500	250	2,00
Shear load parallel to the free edge		with $c \geq$	with $s \geq$	$\alpha_{g II, V \parallel}$		with $c \geq$	with $s \geq$	$\alpha_{g \perp, V \parallel}$
		50	50	2,00		50	50	1,30
		120	500	2,00		120	250	2,00

Table C35: Characteristic resistance under tension and shear load

Anchor size	Sleeve VM-SH	Effective anchorage depth	Characteristic resistance with $c \geq c_{cr}$ and $s \geq s_{cr}$						
			Use condition						
			d/d			w/d w/w			d/d w/d w/w
			24°C / 40°C	50°C / 80°C	72°C / 120°C	24°C / 40°C	50°C / 80°C	72°C / 120°C	all temperature ranges
		h_{ef}	$N_{Rk,b} = N_{Rk,p}^{1)}$						$V_{Rk,b}^{1)}$
		[mm]	[kN]						[kN]
Normalised mean compressive strength $f_b \geq 12 \text{ N/mm}^2$ ²⁾									
M8 / M10 IG-M6	VM-SH 16	130	3,5	3,5	2,5	3,5	3,5	2,5	3,5
M12 / M16 IG-M8 / IG-M10	VM-SH 20	≥ 130	3,5	3,5	2,5	3,5	3,5	2,5	7,0

¹⁾ $N_{Rk,b,c} = N_{Rk,p,c}$ and $V_{Rk,c \parallel} = V_{Rk,c \perp}$ according to Annex C5

²⁾ For lower compressive strengths resistances must be multiplied by the conversion factor according to Table C31. For stones with higher strengths, the shown values are valid without conversion.

Table C36: Displacements

Anchor size	h_{ef}	δ_N / N	δ_{N0}	$\delta_{N\infty}$	δ_v / V	δ_{v0}	$\delta_{v\infty}$
	[mm]	[mm/kN]	[mm]	[mm]	[mm/kN]	[mm]	[mm]
M8 – M12 / IG-M6 – IG-M10	all	0,13	$0,13 \cdot N_{Rk} / 3,5$	$2 \cdot \delta_{N0}$	0,55	$0,55 \cdot V_{Rk} / 3,5$	$1,5 \cdot \delta_{v0}$
M16					0,31	$0,31 \cdot V_{Rk} / 3,5$	

Table C37: Characteristic resistance under fire exposure

Anchor size	Sleeve	Effective anchorage depth	Characteristic resistance			
			$N_{Rk,b,fi} = N_{Rk,p,fi} = V_{Rk,b,fi}$			
			h_{ef}	R30	R60	R90
		[mm]	[kN]			
M8/M10/IG-M6	VM-SH 16	130	0,37	0,27	0,17	no performance assessed
M12/IG-M8	VM-SH 20	≥ 130				
M16/IG-M10	VM-SH 20	≥ 130				

Sikla Injection System VMU plus for masonry

Performances - Hollow calcium silica brick KSL-12DF
Group factors, characteristic resistances and displacements

Annex C16

Brick type: Solid clay brick MZ-1DF

Table C38: Description

Brick type	Solid clay brick MZ-1DF	
Density	ρ [kg/dm ³]	$\geq 2,0$
Normalised mean compressive strength	f_b [N/mm ²]	≥ 20
Conversion factor for lower compressive strengths		$(f_b / 20)^{0,5} \leq 1,0$
Norm	[-]	EN 771-1:2011+A1:2015
Producer (country code)	[-]	e.g. Wienerberger (DE)
Brick dimensions	[mm]	$\geq 240 \times 115 \times 55$
Drilling method	[-]	Hammer drilling

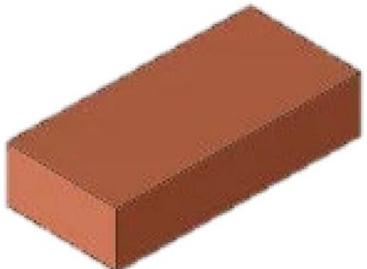


Table C39: Installation parameter

Anchor size		M8	M10	M12	M16	IG-M6	IG-M8	IG-M10
Installation torque	T_{inst} [Nm]	≤ 10	≤ 10	≤ 10	≤ 10	≤ 10	≤ 10	≤ 10
Edge distance	c_{cr} [mm]	150 (for shear loads perpendicular to the free edge: $c_{cr} = 240$)						
Minimum edge distance	c_{min} [mm]	60						
Spacing	$s_{cr,II}$ [mm]	240						
	$s_{cr,L}$ [mm]	130						
Minimum spacing	$s_{min,II}; s_{min,L}$ [mm]	65						

Table C40: Reduction factors for single anchors at the edge










Tension load			Shear load					
			perpendicular to the free edge			parallel to the free edge		
	with $c \geq$	$\alpha_{edge,N}$		with $c \geq$	$\alpha_{edge,V,L}$		with $c \geq$	$\alpha_{edge,V,II}$
	60	0,75		60	0,10		60	0,30
	150	1,00		100	0,50		100	0,65
	180	1,00		240	1,00		150	1,00

Table C41: Factors for anchor groups

	Position parallel to horizontal joint				Position perpendicular to horizontal joint			
		with $c \geq$	with $s \geq$	$\alpha_{g,II,N}$		with $c \geq$	with $s \geq$	$\alpha_{g,I,N}$
Tension load		60	65	0,85		60	65	1,00
		150	65	1,15		150	65	1,20
		150	240	2,00		150	130	2,00
Shear load perpendicular to the free edge		with $c \geq$	with $s \geq$	$\alpha_{g,II,V,L}$		with $c \geq$	with $s \geq$	$\alpha_{g,I,V,L}$
		60	65	0,40		60	65	0,30
		240	65	2,00		240	65	2,00
		240	240	2,00		240	130	2,00
Shear load parallel to the free edge		with $c \geq$	with $s \geq$	$\alpha_{g,II,V,II}$		with $c \geq$	with $s \geq$	$\alpha_{g,I,V,II}$
		60	65	1,75		60	65	1,10
		150	65	2,00		150	65	2,00
		150	240	2,00		150	130	2,00

Sikla Injection System VMU plus for masonry

Performances – Solid clay brick MZ-1DF
Description, installation parameters, reduction factors

Annex C17

Brick type: Solid clay brick MZ-1DF – continuation

Table C42: Characteristic resistance under tension and shear load

Anchor size	Sleeve	Effective anchorage depth	Characteristic resistance with $c \geq c_{cr}$ and $s \geq s_{cr}$						
			Use condition						
			d/d			w/d w/w			d/d w/d w/w
			24°C / 40°C	50°C / 80°C	72°C / 120°C	24°C / 40°C	50°C / 80°C	72°C / 120°C	all temperature ranges
h_{ef}	$N_{Rk,b} = N_{Rk,p}^{1)}$						$V_{Rk,b}^{1)}$		
[mm]	[kN]						[kN]		
Normalised mean compressive strength $f_b \geq 20 \text{ N/mm}^2$ ²⁾									
M8	-	80	7,0	6,0	6,0	7,0	6,0	6,0	8,0
M10 / IG-M6	-	≥ 90	7,0	6,0	6,0	7,0	6,0	6,0	8,0
M12 / IG-M8	-	≥ 100	7,0	6,0	6,0	7,0	6,0	6,0	8,0
M16 / IG-M10	-	≥ 100	8,0	6,5	6,5	8,0	6,5	6,5	12,0
M8	VM-SH 12	80	7,0	6,0	6,0	7,0	6,0	6,0	8,0
M8 / M10 IG-M6	VM-SH 16	≥ 85	7,0	6,0	6,0	7,0	6,0	6,0	8,0
M12 IG-M8	VM-SH 20	≥ 85	7,0	6,0	6,0	7,0	6,0	6,0	8,0
M16 IG-M10	VM-SH 20	≥ 85	8,0	6,5	6,5	8,0	6,5	6,5	12,0

¹⁾ $N_{Rk,b,c} = N_{Rk,p,c}$ and $V_{Rk,c,II} = V_{Rk,c,I}$ according to Annex C5

²⁾ For lower compressive strengths resistances must be multiplied by the conversion factor according to Table C38. For stones with higher strengths, the shown values are valid without conversion.

Table C43: Displacements

Anchor size	h_{ef}	δ_N / N	δ_{N0}	$\delta_{N\infty}$	δ_v / V	δ_{v0}	$\delta_{v\infty}$
	[mm]	[mm/kN]	[mm]	[mm]	[mm/kN]	[mm]	[mm]
M8 – M12 / IG-M6 – IG-M10	all	0,1	0,1 * $N_{Rk} / 3,5$	2 * δ_{N0}	0,3	0,3 * $V_{Rk} / 3,5$	1,5 * δ_{v0}
M16					0,1	0,1 * $V_{Rk} / 3,5$	

Sikla Injection System VMU plus for masonry

Performances - Solid clay brick MZ-1DF
Characteristic resistance and displacements

Annex C18

Brick type: Solid clay brick MZ-2DF

Table C44: Description

Brick type		Solid clay brick MZ-2DF
Density	ρ [kg/dm ³]	$\geq 2,0$
Normalised mean compressive strength	f_b [N/mm ²]	≥ 28
Conversion factor for lower compressive strengths		$(f_b / 28)^{0,5} \leq 1,0$
Norm	[-]	EN 771-1:2011+A1:2015
Producer (country code)	[-]	e.g. Wienerberger (DE)
Brick dimensions	[mm]	$\geq 240 \times 115 \times 113$
Drilling method	[-]	Hammer drilling

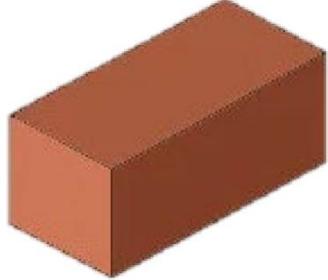


Table C45: Installation parameter

Anchor size		M8	M10	M12	M16	IG-M6	IG-M8	IG-M10
Installation torque	T_{inst} [Nm]	≤ 10	≤ 10	≤ 10	≤ 10	≤ 10	≤ 10	≤ 10
Edge distance (under fire exposure)	$c_{cr}, (c_{cr,fi})$ [mm]	150 (2 h_{ef}) (for shear loads perpendicular to the free edge: $c_{cr} = 240$)						
Minimum edge distance	c_{min} [mm]	50						
Spacing (under fire exposure)	$s_{cr,II} (s_{cr,fi,II})$ [mm]	240 (4 h_{ef})						
	$s_{cr,\perp} (s_{cr,fi,\perp})$ [mm]	240 (4 h_{ef})						
Minimum spacing	$s_{min,II}; s_{min,\perp}$ [mm]	50						

Table C46: Reduction factors for single anchors at the edge










Tension load			Shear load					
			perpendicular to the free edge			parallel to the free edge		
	with $c \geq 50^1$	$\alpha_{edge,N}$ 1,00		with $c \geq 50$	$\alpha_{edge,V\perp}$ 0,20		with $c \geq 50$	$\alpha_{edge,V\parallel}$ 1,00
	150 ¹⁾	1,00		125	0,50		150	1,00
	150	1,00		240	1,00		150	1,00

Table C47: Factors for anchor groups

		Position parallel to horizontal joint			Position perpendicular to horizontal joint			
Tension load		with $c \geq 50^1$	with $s \geq 50$	$\alpha_{g,II,N}$ 1,50		with $c \geq 50^1$	with $s \geq 50$	$\alpha_{g,\perp,N}$ 0,80
		150 ¹⁾	240	2,00		150 ¹⁾	240	2,00
		180 ²⁾	60	1,00		180 ²⁾	60	1,00
		180 ²⁾	240	1,55		180 ²⁾	120	2,00
		240 ²⁾	240	2,00		180 ²⁾	120	2,00
Shear load perpendicular to the free edge		with $c \geq 50$	with $s \geq 50$	$\alpha_{g,II,V\perp}$ 0,40		with $c \geq 50$	with $s \geq 50$	$\alpha_{g,\perp,V\perp}$ 0,20
		240	50	1,20		240	50	0,60
		240	240	2,00		240	125	1,00
		240	240	2,00		240	240	2,00
Shear load parallel to the free edge		with $c \geq 50$	with $s \geq 50$	$\alpha_{g,II,V\parallel}$ 1,20		with $c \geq 50$	with $s \geq 50$	$\alpha_{g,\perp,V\parallel}$ 1,00
		150	240	2,00		50	125	1,00
						50	240	2,00
						150	240	2,00

¹⁾ All applications, except for $h_{ef} = 200$ mm and without sleeve (for Table C46 and C47)

²⁾ Only for application with $h_{ef} = 200$ mm and without sleeve

Sikla Injection System VMU plus for masonry

Performances – Solid clay brick MZ-2DF
Description, installation parameters, reduction- and group factors

Annex C19

Brick type: Solid clay brick MZ-2DF – continuation

Table C48: Characteristic resistance under tension and shear load

Anchor size	Sleeve	Effective anchorage depth	Characteristic resistance with $c \geq c_{cr}$ and $s \geq s_{cr}$						
			Use condition						
			d/d			w/d w/w			d/d w/d w/w
			24°C / 40°C	50°C / 80°C	72°C / 120°C	24°C / 40°C	50°C / 80°C	72°C / 120°C	all temperature ranges
h_{ef}	$N_{Rk,b} = N_{Rk,p}^{1)}$						$V_{Rk,b}^{1)}$		
[mm]	[kN]						[kN]		
Normalised mean compressive strength $f_b \geq 28 \text{ N/mm}^2$ ²⁾									
M8	-	80	9,0	9,0	7,5	9,0	9,0	7,5	9,5
M10 / IG-M6	-	≥ 90	9,0	9,0	7,5	9,0	9,0	7,5	9,5
M12 / IG-M8	-	≥ 100	9,0	9,0	7,5	9,0	9,0	7,5	12,0
M16 / IG-M10	-	≥ 100	9,0	9,0	7,5	9,0	9,0	7,5	12,0 ³⁾
M10 / M12 IG-M6 / IG-M8	-	200	11,5	11,5	10,0	6,0	6,0	5,0	8,0
M16 / IG-M10	-	200	11,5	11,5	10,0	6,0	6,0	5,0	12,0
M8	VM-SH 12	80	9,0	9,0	7,5	9,0	9,0	7,5	9,5
M8 / M10 IG-M6	VM-SH 16	≥ 85	9,0	9,0	7,5	9,0	9,0	7,5	9,5
M12 / IG-M8	VM-SH 20	≥ 85	9,0	9,0	7,5	9,0	9,0	7,5	12,0
M16 / IG-M10	VM-SH 20	≥ 85	9,0	9,0	7,5	9,0	9,0	7,5	12,0 ³⁾

¹⁾ $N_{Rk,b,c} = N_{Rk,p,c}$ and $V_{Rk,c,II} = V_{Rk,c,I}$ according to Annex C5

²⁾ For lower compressive strengths resistances must be multiplied by the conversion factor according to Table C44. For stones with higher strengths, the shown values are valid without conversion.

³⁾ Valid for all stone strengths with min. 10 N/mm²

Table C49: Displacements

Anchor size	h_{ef}	δ_N / N	δ_{N0}	$\delta_{N\infty}$	δ_V / V	δ_{V0}	$\delta_{V\infty}$
	[mm]	[mm/kN]	[mm]	[mm]	[mm/kN]	[mm]	[mm]
M8 – M12 / IG-M6 – IG-M10	all	0,1	0,1 * $N_{Rk} / 3,5$	2 * δ_{N0}	0,3	0,3 * $V_{Rk} / 3,5$	1,5 * δ_{V0}
M16					0,1	0,1 * $V_{Rk} / 3,5$	

Sikla Injection System VMU plus for masonry

Performance - Solid clay brick MZ-2DF
Characteristic resistance and displacements

Annex C20

Table C50: Characteristic resistance under fire exposure

Anchor size	Sleeve	Effective anchorage depth	Characteristic resistance $N_{Rk,b,fi} = N_{Rk,p,fi} = V_{Rk,b,fi}$			
			R30	R60	R90	R120
		h_{ef} [mm]	[kN]			
M8	-	80	0,51	0,44	0,36	0,33
M10 / IG-M6	-	≥ 90				
M12 / IG-M8	-	≥ 100				
M16 / IG-M10	-	≥ 100				
M8	VM-SH 12	80	0,36	0,26	0,15	0,10
M8 / M10 / IG-M6	VM-SH 16	≥ 85	0,36	0,26	0,15	0,10
		130	0,92	0,74	0,57	0,49
M12 / M16 IG-M8 / IG-M10	VM-SH 20	≥ 85	0,36	0,26	0,15	0,10
		≥ 130	0,92	0,74	0,57	0,49

Sikla Injection System VMU plus for masonry

Performance - Solid clay brick MZ-2DF
Characteristic resistance under fire exposure

Annex C21

Brick type: Hollow clay brick HLZ-10 DF

Table C51: Description

Brick type		Hollow clay brick HLZ-10 DF
Density	ρ [kg/dm ³]	$\geq 1,25$
Normalised mean compressive strength	f_b [N/mm ²]	≥ 20
Conversion factor for lower compressive strengths		$(f_b / 20)^{0,5} \leq 1,0$
Norm	[-]	EN 771-1:2011+A1:2015
Producer (country code)	[-]	e.g. Wienerberger (DE)
Brick dimensions	[mm]	300 x 240 x 249
Drilling method	[-]	Rotary drilling

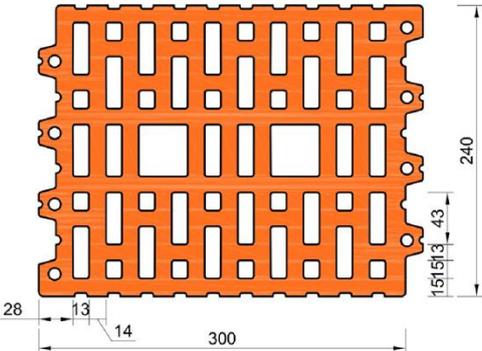






Table C52: Installation parameter

Anchor size		M8	M10	M12	M16	IG-M6	IG-M8	IG-M10
Installation torque	T_{inst} [Nm]	≤ 5	≤ 10	≤ 10	≤ 10	≤ 5	≤ 5	≤ 10
Edge distance (under fire exposure)	$c_{cr}; (c_{cr,fi})$ [mm]	120 (2 h_{ef}) (for shear loads perpendicular to the free edge: $c_{cr} = 300$)						
Minimum edge distance	c_{min} [mm]	50						
Characteristic spacing (under fire exposure)	$s_{cr, } (s_{cr,fi, })$ [mm]	300 (4 h_{ef})						
	$s_{cr,\perp} (s_{cr,fi,\perp})$ [mm]	250 (4 h_{ef})						
Minimum spacing	$s_{min, }; s_{min,\perp}$ [mm]	50						

Table C53: Reduction factors for single anchors at the edge

Tension load			Shear load					
			perpendicular to the free edge			parallel to the free edge		
	with $c \geq$	$\alpha_{edge,N}$		with $c \geq$	$\alpha_{edge,V\perp}$		with $c \geq$	$\alpha_{edge,V\parallel}$
	50	1,00		50	0,20		50	1,00
	120	1,00		300	1,00		120	1,00

Sikla Injection System VMU plus for masonry

Performances – Hollow clay brick HLZ 10DF
Description, installation parameters, reduction factors

Annex C22

Brick type: Hollow clay brick HLZ-10 DF – continuation

Table C54: Factors for anchor groups

	Position parallel to horizontal joint				Position perpendicular to horizontal joint			
Tension load		with c ≥	with s ≥	$\alpha_{g II, N}$		with c ≥	with s ≥	$\alpha_{g \perp, N}$
		50	50	1,55		50	50	1,00
		120	300	2,00		120	250	2,00
Shear load perpendicular to the free edge		with c ≥	with s ≥	$\alpha_{g II, V \perp}$		with c ≥	with s ≥	$\alpha_{g \perp, V \perp}$
		50	50	0,30		50	50	0,20
		300	50	1,40		300	50	1,00
		300	300	2,00		300	250	2,00
Shear load parallel to the free edge		with c ≥	with s ≥	$\alpha_{g II, V \parallel}$		with c ≥	with s ≥	$\alpha_{g \perp, V \parallel}$
		50	50	1,85		50	50	1,00
		120	300	2,00		120	250	2,00

Table C55: Characteristic resistance under tension and shear load

Anchor size	Sleeve	Effective anchorage depth	Characteristic resistance with $c \geq c_{cr}$ and $s \geq s_{cr}$						
			Use condition						
			d/d			w/d w/w			d/d w/d w/w
			24°C / 40°C	50°C / 80°C	72°C / 120°C	24°C / 40°C	50°C / 80°C	72°C / 120°C	all temperature ranges
		h_{ef}	$N_{Rk,b} = N_{Rk,p} \text{ } ^1)$						$V_{Rk,b} \text{ } ^1)$
		[mm]	[kN]						[kN]
Normalised mean compressive strength $f_b \geq 20 \text{ N/mm}^2 \text{ } ^2)$									
M8	VM-SH 12	80	2,5	2,5	2,0	2,5	2,5	2,0	8,0
M8 / M10 / IG-M6	VM-SH 16	≥ 85	2,5	2,5	2,0	2,5	2,5	2,0	8,0
M12 / IG-M8	VM-SH 20	≥ 85	5,0	5,0	4,5	5,0	5,0	4,5	8,0
M16 / IG-M10	VM-SH 20	≥ 85	5,0	5,0	4,5	5,0	5,0	4,5	11,5

¹⁾ $N_{Rk,b,c} = N_{Rk,p,c}$ and $V_{Rk,c \perp} = V_{Rk,c \parallel}$ according to Annex C5

²⁾ For lower compressive strengths resistances must be multiplied by the conversion factor according to Table C51. For stones with higher strengths, the shown values are valid without conversion.

Table C56: Displacements

Anchor size	h_{ef}	δ_N / N	δ_{N0}	$\delta_{N\infty}$	δ_V / V	δ_{V0}	$\delta_{V\infty}$
	[mm]	[mm/kN]	[mm]	[mm]	[mm/kN]	[mm]	[mm]
M8 – M12 / IG-M6 – IG-M10	all	0,13	0,13 * $N_{Rk} / 3,5$	2 * δ_{N0}	0,55	0,55 * $V_{Rk} / 3,5$	1,5 * δ_{V0}
M16					0,31	0,31 * $V_{Rk} / 3,5$	

Table C57: Characteristic resistance under fire exposure

Anchor size	Sleeve	Effective anchorage depth	Characteristic resistance $N_{Rk,b,fi} = N_{Rk,p,fi} = V_{Rk,b,fi}$				
			h_{ef}	R30	R60	R90	R120
			[mm]	[kN]			
M8 / M10 / IG-M6	VM-SH 16	130	0,57	0,39	0,21	0,12	
M12 / M16 / IG-M8 / IG-M10	VM-SH 20	≥ 130					

Sikla Injection System VMU plus for masonry

Performances – Hollow clay brick HLZ 10DF
Group factors, characteristic resistance and displacements

Annex C23

Brick type: Hollow clay brick Porotherm Homebric

Table C58: Description

Brick type		Hollow clay brick Porotherm Homebric
Density	ρ [kg/dm ³]	$\geq 0,70$
Normalised mean compressive strength	f_b [N/mm ²]	≥ 10
Conversion factor for lower compressive strengths		$(f_b / 10)^{0,5} \leq 1,0$
Norm	[-]	EN 771-1:2011+A1:2015
Producer (country code)	[-]	e.g. Wienerberger (FR)
Brick dimensions	[mm]	500 x 200 x 299
Drilling method	[-]	Rotary drilling

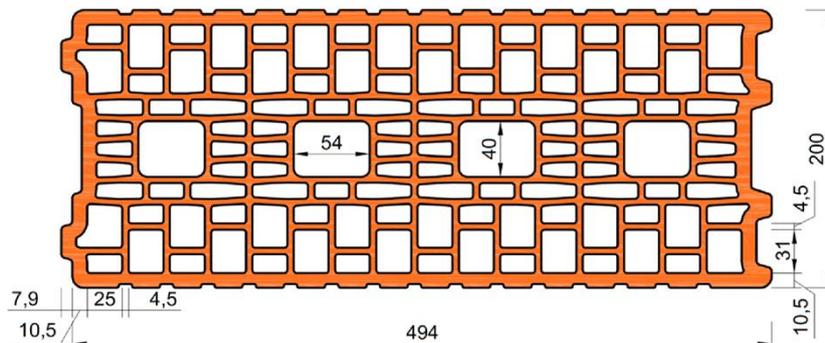
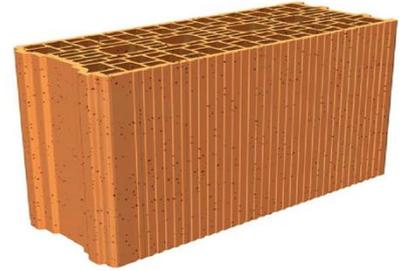


Table C59: Installation parameter

Anchor size		M8	M10	M12	M16	IG-M6	IG-M8	IG-M10
Installation torque	T_{inst} [Nm]	≤ 2	≤ 2	≤ 2	≤ 2	≤ 2	≤ 2	≤ 2
Edge distance	c_{cr} [mm]	120 (for shear loads perpendicular to the free edge: $c_{cr} = 500$)						
Minimum edge distance	c_{min} [mm]	120						
Spacing	$s_{cr,II}$ [mm]	500						
	$s_{cr,L}$ [mm]	300						
Minimum spacing	$s_{min,II}$ [mm]	120						
	$s_{min,L}$ [mm]							

Table C60: Reduction factors for single anchors at the edge

Tension load			Shear load					
			perpendicular to the free edge			parallel to the free edge		
			with $c \geq$	$\alpha_{edge,N}$	with $c \geq$	$\alpha_{edge,V,I}$	with $c \geq$	$\alpha_{edge,V,II}$
	120	1,00		120	0,30		120	0,60
	120	1,00		250	0,60		200	1,00
	120	1,00		500	1,00			

Sikla Injection System VMU plus for masonry

Performances – Hollow clay brick Porotherm Homebric
Description, installation parameters, reduction factors

Annex C24

Brick type: Hollow clay brick Porotherm Homebric – continuation

Table C61: Factors for anchor groups

	Position parallel to horizontal joint				Position perpendicular to horizontal joint				
Tension load		with c ≥ 120	with s ≥ 100	$\alpha_{g II, N}$		with c ≥ 120	with s ≥ 100	$\alpha_{g \perp, N}$	
		200	100	1,00		200	100	1,20	
		120	500	2,00		120	300	2,00	
Shear load perpendicular to the free edge		with c ≥ 120	with s ≥ 100	$\alpha_{g II, V \perp}$		with c ≥ 120	with s ≥ 100	$\alpha_{g \perp, V \perp}$	
		250	100	0,30		250	100	0,60	
		500	100	1,00		120	300	2,00	
		120	500	2,00					
Shear load parallel to the free edge		with c ≥ 120	with s ≥ 100	$\alpha_{g II, V \parallel}$		with c ≥ 120	with s ≥ 100	$\alpha_{g \perp, V \parallel}$	
		120	500	1,00		120	300	1,00	

Table C62: Characteristic resistance under tension and shear load

Anchor size	Sleeve	Effective anchorage depth	Characteristic resistance with $c \geq c_{cr}$ and $s \geq s_{cr}$						
			Use condition						
			d/d			w/d			d/d
						w/w			w/w
			24°C / 40°C	50°C / 80°C	72°C / 120°C	24°C / 40°C	50°C / 80°C	72°C / 120°C	all temperature ranges
		h_{ef}	$N_{Rk,b} = N_{Rk,p}^{1)}$						$V_{Rk,b}^{1)}$
		[mm]	[kN]						[kN]
Normalised mean compressive strength $f_b \geq 10 \text{ N/mm}^2$ ²⁾									
M8	VM-SH 12	80	1,2			3,0			
M8 / M10 / IG-M6	VM-SH 16	≥ 85	1,2			3,0			
		130	1,5			3,5			
M12 / M16 / IG-M8 / IG-M10	VM-SH 20	≥ 85	1,2			4,0			
		≥ 130	1,5			4,0			

¹⁾ $N_{Rk,b,c} = N_{Rk,p,c}$ and $V_{Rk,c \parallel} = V_{Rk,c \perp}$ according to Annex C5

²⁾ For lower compressive strengths resistances must be multiplied by the conversion factor according to Table C58. For stones with higher strengths, the shown values are valid without conversion.

Table C63: Displacements

Anchor size	h_{ef}	δ_N / N	δ_{N0}	$\delta_{N\infty}$	δ_v / V	δ_{v0}	$\delta_{v\infty}$
	[mm]	[mm/kN]	[mm]	[mm]	[mm/kN]	[mm]	[mm]
M8 – M12 / IG-M6 – IG-M10	all	0,13	0,13 * N_{Rk} / 3,5	2 * δ_{N0}	0,55	0,55 * V_{Rk} / 3,5	1,5 * δ_{v0}
M16					0,31	0,31 * V_{Rk} / 3,5	

Sikla Injection System VMU plus for masonry

Performances – Hollow clay brick Porotherm Homebric
Group factors, characteristic resistance and displacements

Annex C25

Brick type: Hollow clay brick BGV Thermo

Table C64: Description

Brick type		Hollow clay brick BGV Thermo
Density	ρ [kg/dm ³]	≥ 0,60
Normalised mean compressive strength	f_b [N/mm ²]	≥ 10
Conversion factor for lower compressive strengths		$(f_b / 10)^{0,5} \leq 1,0$
Norm	[-]	EN 771-1:2011+A1:2015
Producer (country code)	[-]	e.g. Leroux (FR)
Brick dimensions	[mm]	500 x 200 x 314
Drilling method	[-]	Rotary drilling

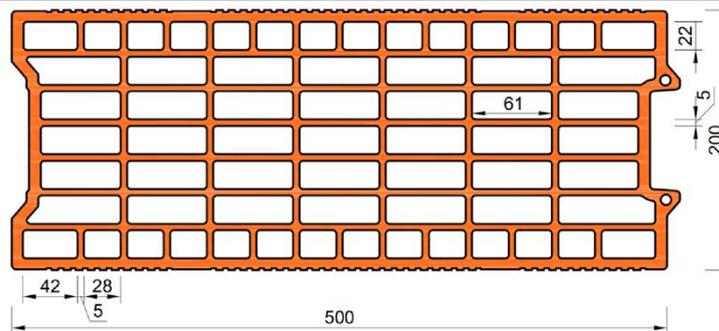


Table C65: Installation parameter

Anchor size		M8	M10	M12	M16	IG-M6	IG-M8	IG-M10
Installation torque	T_{inst} [Nm]	≤ 2	≤ 2	≤ 2	≤ 2	≤ 2	≤ 2	≤ 2
Edge distance	c_{cr} [mm]	120 (for shear loads perpendicular to the free edge: $c_{cr} = 500$)						
Minimum edge distance	c_{min} [mm]	120						
Spacing	$s_{cr,II}$ [mm]	500						
	$s_{cr,L}$ [mm]	315						
Minimum spacing	$s_{min,II}$ [mm]	120						
	$s_{min,L}$ [mm]							

Table C66: Reduction factors for single anchors at the edge

Tension load			Shear load					
			perpendicular to the free edge			perpendicular to the free edge		
with $c \geq$	$\alpha_{edge,N}$		with $c \geq$	$\alpha_{edge,V \perp}$		with $c \geq$	$\alpha_{edge,V \parallel}$	
120	1,00		120	0,30		120	0,60	
120	1,00		250	0,60		250	1,00	
			500	1,00				

Sikla Injection System VMU plus for masonry

Performance - Hollow clay brick BGV Thermo
Description, Installation parameters and reduction factors

Annex C26

Brick type: Hollow clay brick BGV Thermo – continuation

Table C67: Factors for anchor groups

	Position parallel to horizontal joint			Position perpendicular to horizontal joint				
Tension load		with $c \geq 120$	with $s \geq 100$	$\alpha_{g II, N}$		with $c \geq 120$	with $s \geq 100$	$\alpha_{g \perp, N}$
		120	100	1,00		120	100	1,00
		200	100	1,70		200	100	1,10
		120	500	2,00		120	315	2,00
Shear load perpendicular to the free edge		with $c \geq 120$	with $s \geq 100$	$\alpha_{g II, V \perp}$		with $c \geq 120$	with $s \geq 100$	$\alpha_{g \perp, V \perp}$
		120	100	1,00		120	100	1,00
		120	500	2,00		120	315	2,00
Shear load parallel to the free edge		with $c \geq 120$	with $s \geq 100$	$\alpha_{g II, V \parallel}$		with $c \geq 120$	with $s \geq 100$	$\alpha_{g \perp, V \parallel}$
		120	100	1,00		120	100	1,00
		120	500	2,00		120	315	2,00

Table C68: Characteristic resistance under tension and shear load

Anchor size	Sleeve	Effective anchorage depth	Characteristic resistance with $c \geq c_{cr}$ and $s \geq s_{cr}$						
			Use condition						
			d/d			w/d			d/d
			24°C / 40°C	50°C / 80°C	72°C / 120°C	24°C / 40°C	50°C / 80°C	72°C / 120°C	w/w
		h_{ef}	$N_{Rk,b} = N_{Rk,p}^{1)}$						$V_{Rk,b}^{1)}$
		[mm]	[kN]						[kN]
Normalised mean compressive strength $f_b \geq 10 \text{ N/mm}^2$ ²⁾									
M8	VM-SH 12	80	0,9						3,5
M8 / M10 / IG-M6	VM-SH 16	≥ 85	0,9						3,5
		130	2,0	2,0	1,5	2,0	2,0	1,5	4,0
M12 / M16 / IG-M8 / IG-M10	VM-SH 20	≥ 85	0,9						4,0
		≥ 130	2,0	2,0	1,5	2,0	2,0	1,5	4,0

¹⁾ $N_{Rk,b,c} = N_{Rk,p,c}$ and $V_{Rk,c \parallel} = V_{Rk,c \perp}$ according to Annex C5

²⁾ For lower compressive strengths resistances must be multiplied by the conversion factor according to Table C64. For stones with higher strengths, the shown values are valid without conversion.

Table C69: Displacements

Anchor size	h_{ef}	δ_N / N	δ_{N0}	$\delta_{N\infty}$	δ_v / V	δ_{v0}	$\delta_{v\infty}$
	[mm]	[mm/kN]	[mm]	[mm]	[mm/kN]	[mm]	[mm]
M8 – M12 / IG-M6 – IG-M10	all	0,13	0,13 * $N_{Rk} / 3,5$	2 * δ_{N0}	0,55	0,55 * $V_{Rk} / 3,5$	1,5 * δ_{v0}
M16					0,31	0,31 * $V_{Rk} / 3,5$	

Sikla Injection System VMU plus for masonry

Performances – Hollow clay brick BGV Thermo
Group factors, characteristic resistance and displacements

Annex C27

Brick type: Hollow clay brick Calibric R+

Table C70: Description

Brick type		Hollow clay brick Calibric R+
Density	ρ [kg/dm ³]	≥ 0,60
Normalised mean compressive strength	f_b [N/mm ²]	≥ 12
Conversion factor for lower compressive strengths		$(f_b / 12)^{0,5} \leq 1,0$
Norm	[-]	EN 771-1:2011+A1:2015
Producer (country code)	[-]	e.g. Leroux (FR)
Brick dimensions	[mm]	500 x 200 x 314
Drilling method	[-]	Rotary drilling

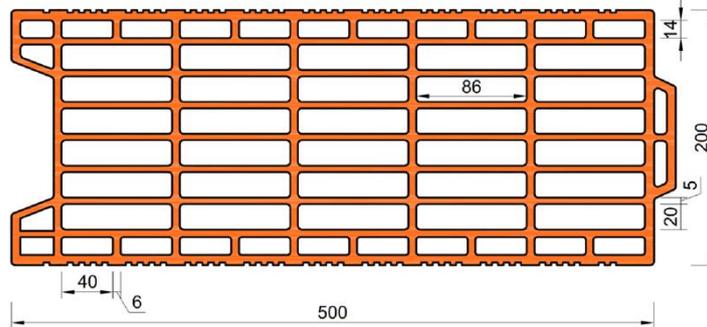


Table C71: Installation parameter

Anchor size		M8	M10	M12	M16	IG-M6	IG-M8	IG-M10
Installation torque	T_{inst} [Nm]	≤ 2	≤ 2	≤ 2	≤ 2	≤ 2	≤ 2	≤ 2
Edge distance	c_{cr} [mm]	120 (for shear loads perpendicular to the free edge: $c_{cr} = 500$)						
Minimum edge distance	c_{min} [mm]	120						
Spacing	$s_{cr, II}$ [mm]	500						
	$s_{cr, \perp}$ [mm]	315						
Minimum spacing	$s_{min, II}$ [mm]	120						
	$s_{min, \perp}$ [mm]							

Table C72: Reduction factors for single anchors at the edge

Tension load			Shear load					
			perpendicular to the free edge			perpendicular to the free edge		
			with $c \geq$			with $c \geq$		
			$\alpha_{edge, V \perp}$			$\alpha_{edge, V II}$		
	with $c \geq$	$\alpha_{edge, N}$		with $c \geq$	$\alpha_{edge, V \perp}$		with $c \geq$	$\alpha_{edge, V II}$
	120	1,00		120	0,15		120	0,30
	120	1,00		250	0,30		250	1,00
	120	1,00		500	1,00		250	1,00

Sikla Injection System VMU plus for masonry

Performances – Hollow clay brick Calibric R+
Description, installation parameters, reduction factors

Annex C28

Brick type: Hollow clay brick Calibric R+ – continuation

Table C73: Factors for anchor groups

	Position parallel to horizontal joint			Position perpendicular to horizontal joint				
Tension load		with $c \geq$	with $s \geq$	$\alpha_{g II, N}$		with $c \geq$	with $s \geq$	$\alpha_{g \perp, N}$
		120	100	1,00		120	100	1,00
		175	100	1,70		175	100	1,10
		120	500	2,00		120	315	2,00
Shear load perpendicular to the free edge		with $c \geq$	with $s \geq$	$\alpha_{g II, V \perp}$		with $c \geq$	with $s \geq$	$\alpha_{g \perp, V \perp}$
		120	100	1,00		120	100	1,00
		120	500	2,00		120	315	2,00
Shear load parallel to the free edge		with $c \geq$	with $s \geq$	$\alpha_{g II, V \parallel}$		with $c \geq$	with $s \geq$	$\alpha_{g \perp, V \parallel}$
		120	100	1,00		120	100	1,00
		120	500	2,00		120	315	2,00

Table C74: Characteristic resistance under tension and shear load

Anchor size	Sleeve	Effective anchorage depth	Characteristic resistance with $c \geq c_{cr}$ and $s \geq s_{cr}$						
			Use condition						
			d/d			w/d			d/d
			24°C / 40°C	50°C / 80°C	72°C / 120°C	24°C / 40°C	50°C / 80°C	72°C / 120°C	w/w
		h_{ef}	$N_{Rk,b} = N_{Rk,p}^{1)}$						$V_{Rk,b}^{1)}$
		[mm]	[kN]						[kN]
Normalised mean compressive strength $f_b \geq 12 \text{ N/mm}^2$ ²⁾									
M8	VM-SH 12	80	1,2	1,2	0,9	1,2	1,2	0,9	4,0
M8 / M10 / IG-M6	VM-SH16	≥ 85	1,2	1,2	0,9	1,2	1,2	0,9	5,5
		130	1,5	1,5	1,2	1,5	1,5	1,2	5,5
M12 / M16 IG-M8 / IG-M10	VM-SH20	≥ 85	1,2	1,2	0,9	1,2	1,2	0,9	8,5
		≥ 130	1,5	1,5	1,2	1,5	1,5	1,2	8,5

¹⁾ $N_{Rk,b,c} = N_{Rk,p,c}$ and $V_{Rk,c \perp} = V_{Rk,c \perp}$ according to Annex C5

²⁾ For lower compressive strengths resistances must be multiplied by the conversion factor according to Table C70. For stones with higher strengths, the shown values are valid without conversion.

Table C75: Displacements

Anchor size	h_{ef}	δ_N / N	δ_{N0}	$\delta_{N\infty}$	δ_v / V	δ_{v0}	$\delta_{v\infty}$
	[mm]	[mm/kN]	[mm]	[mm]	[mm/kN]	[mm]	[mm]
M8 – M12 / IG-M6 – IG-M10	all	0,13	0,13* N_{Rk} / 3,5	2* δ_{N0}	0,55	0,55* V_{Rk} / 3,5	1,5* δ_{v0}
M16					0,31	0,31* V_{Rk} / 3,5	

Sikla Injection System VMU plus for masonry

Performances – Hollow clay brick Calibric R+
Group factors, characteristic resistance and displacements

Annex C29

Brick type: Hollow clay brick Urbanbric

Table C76: Description

Brick type		Hollow clay brick Urbanbric
Density	ρ [kg/dm ³]	$\geq 0,70$
Normalised mean compressive strength	f_b [N/mm ²]	≥ 12
Conversion factor for lower compressive strengths		$(f_b / 12)^{0,5} \leq 1,0$
Norm	[-]	EN 771-1:2011+A1:2015
Producer (country code)	[-]	e.g. Imerys (FR)
Brick dimensions	[mm]	560 x 200 x 274
Drilling method	[-]	Rotary drilling

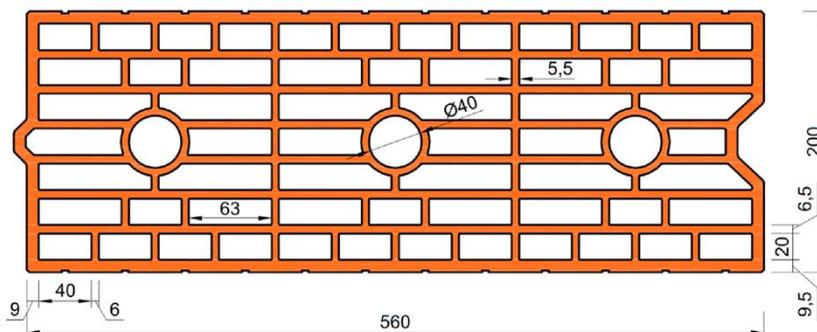
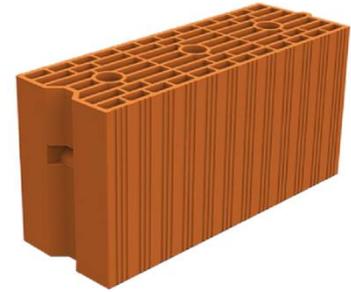


Table C77: Installation parameter

Anchor size		M8	M10	M12	M16	IG-M6	IG-M8	IG-M10
Installation torque	T_{inst} [Nm]	≤ 2	≤ 2	≤ 2	≤ 2	≤ 2	≤ 2	≤ 2
Edge distance	c_{cr} [mm]	120 (for shear loads perpendicular to the free edge: $c_{cr} = 500$)						
Minimum edge distance	c_{min} [mm]	120						
Spacing	$s_{cr, II}$ [mm]	560						
	$s_{cr, \perp}$ [mm]	275						
Minimum spacing	$s_{min, II}$ [mm]	100						
	$s_{min, \perp}$ [mm]							

Table C78: Reduction factors for single anchors at the edge

Tension load			Shear load					
			perpendicular to the free edge			perpendicular to the free edge		
			with $c \geq$			with $c \geq$		
			$\alpha_{edge, V \perp}$			$\alpha_{edge, V \parallel}$		
	120	1,00		120	0,25		120	0,50
	120	1,00		250	0,50		250	1,00
	120	1,00		500	1,00		250	1,00

Sikla Injection System VMU plus for masonry

Performances – Hollow clay brick Urbanbric
Description, installation parameters, reduction factors

Annex C30

Brick type: Hollow clay brick Urbanbric – continuation

Table C79: Factors for anchor groups








	Position parallel to horizontal joint			Position perpendicular to horizontal joint				
		with $c \geq$	with $s \geq$	$\alpha_{g II, N}$		with $c \geq$	with $s \geq$	$\alpha_{g L, N}$
Tension load		120	100	1,00		120	100	1,00
		185	100	1,90		185	100	1,10
		120	560	2,00		120	275	2,00
Shear load perpendicular to the free edge		120	100	1,00		120	100	1,00
		120	560	2,00		120	275	2,00
				$\alpha_{g II, V \perp}$				$\alpha_{g L, V \perp}$
Shear load parallel to the free edge		120	100	1,00		120	100	1,00
		120	560	2,00		120	275	2,00
				$\alpha_{g II, V \parallel}$				$\alpha_{g L, V \parallel}$

Table C80: Characteristic resistance under tension and shear load

Anchor size	Sleeve	Effective anchorage depth	Characteristic resistance with $c \geq c_{cr}$ and $s \geq s_{cr}$						
			Use condition						
			d/d			w/d			d/d
			24°C / 40°C	50°C / 80°C	72°C / 120°C	24°C / 40°C	50°C / 80°C	72°C / 120°C	w/w
		h_{ef}	$N_{Rk,b} = N_{Rk,p}^{1)}$						$V_{Rk,b}^{1)}$
		[mm]	[kN]						[kN]
Normalised mean compressive strength $f_b \geq 12 \text{ N/mm}^2$ ²⁾									
M8	VM-SH 12	80	1,2	1,2	0,9	1,2	1,2	0,9	4,5
M8 / M10 / IG-M6	VM-SH 16	≥ 85	1,2	1,2	0,9	1,2	1,2	0,9	4,5
		130	3,0	3,0	2,5	3,0	3,0	2,5	4,5
M12 / M16 IG-M8 / IG-M10	VM-SH 20	≥ 85	1,2	1,2	0,9	1,2	1,2	0,9	5,0
		≥ 130	3,0	3,0	2,5	3,0	3,0	2,5	5,0

¹⁾ $N_{Rk,b,c} = N_{Rk,p,c}$ and $V_{Rk,c II} = V_{Rk,c L}$ according to Annex C5

²⁾ For lower compressive strengths resistances must be multiplied by the conversion factor according to Table C76. For stones with higher strengths, the shown values are valid without conversion.

Table C81: Displacements

Anchor size	h_{ef}	δ_N / N	δ_{N0}	$\delta_{N\infty}$	δ_V / V	δ_{V0}	$\delta_{V\infty}$
	[mm]	[mm/kN]	[mm]	[mm]	[mm/kN]	[mm]	[mm]
M8 – M12 / IG-M6 – IG-M10	all	0,13	0,13* N_{Rk} / 3,5	2* δ_{N0}	0,55	0,55* V_{Rk} / 3,5	1,5* δ_{V0}
M16					0,31	0,31* V_{Rk} / 3,5	

Sikla Injection System VMU plus for masonry

Performances – Hollow clay brick Urbanbric
Group factors, characteristic resistance and displacements

Annex C31

Brick type: Hollow Clay brick Brique Creuse C40

Table C82: Description

Brick type		Hollow clay brick Brique Creuse C40
Density	ρ [kg/dm ³]	≥ 0,70
Normalised mean compressive strength	f_b [N/mm ²]	≥ 12
Conversion factor for lower compressive strengths		$(f_b / 12)^{0,5} \leq 1,0$
Norm	[-]	EN 771-1:2011+A1:2015
Producer (country code)	[-]	e.g. Terreal (FR)
Brick dimensions	[mm]	500 x 200 x 200
Drilling method	[-]	Rotary drilling

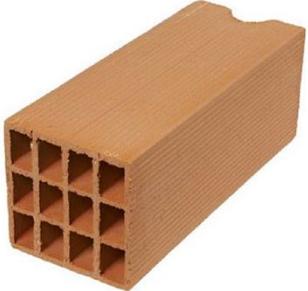
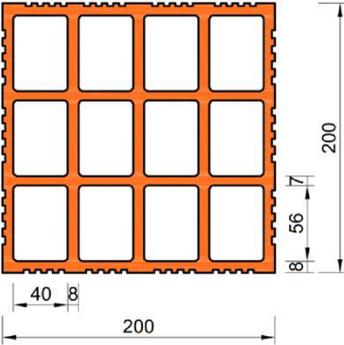






Table C83: Installation parameter

Anchor size		M8	M10	M12	M16	IG-M6	IG-M8	IG-M10
Installation torque	T_{inst} [Nm]	≤ 2	≤ 2	≤ 2	≤ 2	≤ 2	≤ 2	≤ 2
Edge distance	c_{cr} [mm]	120 (for shear loads perpendicular to the free edge: $c_{cr} = 500$)						
Minimum edge distance	c_{min} [mm]	120						
Spacing	$s_{cr, II}$ [mm]	500						
	$s_{cr, \perp}$ [mm]	200						
Minimum spacing	$s_{min, II}$ [mm]	200						
	$s_{min, \perp}$ [mm]	200						

Table C84: Reduction factors for single anchors at the edge

Tension load			Shear load					
			perpendicular to the free edge			perpendicular to the free edge		
	with $c \geq$	$\alpha_{edge, N}$		with $c \geq$	$\alpha_{edge, V \perp}$		with $c \geq$	$\alpha_{edge, V \parallel}$
	120	1,00		120	0,83		120	1,00
	120	1,00		500	1,00		250	1,00

Sikla Injection System VMU plus for masonry

Performances – Hollow clay brick Brique Creuse C40
Description, installation parameters, reduction factors

Annex C32

Brick type: Hollow Clay brick Brique Creuse C40 – continuation

Table C85: Factors for anchor groups

	Position parallel to horizontal joint			Position perpendicular to horizontal joint				
Tension load		with $c \geq$	with $s \geq$	$\alpha_{g II, N}$		with $c \geq$	with $s \geq$	$\alpha_{g \perp, N}$
		120	500	2,00		120	200	2,00
Shear load perpendicular to the free edge		with $c \geq$	with $s \geq$	$\alpha_{g II, V \perp}$		with $c \geq$	with $s \geq$	$\alpha_{g \perp, V \perp}$
		120	500	2,00		120	200	2,00
Shear load parallel to the free edge		with $c \geq$	with $s \geq$	$\alpha_{g II, V \parallel}$		with $c \geq$	with $s \geq$	$\alpha_{g \perp, V \parallel}$
		120	500	2,00		120	200	2,00

Table C86: Characteristic resistance under tension and shear load

Anchor size	Sleeve	Effective anchorage depth	Characteristic resistance with $c \geq c_{cr}$ and $s \geq s_{cr}$						
			Use condition						
			d/d			w/d w/w			d/d w/d w/w
			24°C / 40°C	50°C / 80°C	72°C / 120°C	24°C / 40°C	50°C / 80°C	72°C / 120°C	all temperature ranges
		h_{ef}	$N_{Rk, b} = N_{Rk, p}^{1)}$						$V_{Rk, b}^{1)}$
		[mm]	[kN]						[kN]
Normalised mean compressive strength $f_b \geq 12 \text{ N/mm}^2$ ²⁾									
M8	VM-SH 12	80							
M8 / M10 / IG-M6	VM-SH 16	≥ 85	1,2	1,2	0,9	1,2	1,2	0,9	1,5
M12 / M16 / IG-M8 / IG-M10	VM-SH 20	≥ 85							

¹⁾ $N_{Rk, b, c} = N_{Rk, p, c}$ and $V_{Rk, c \parallel} = V_{Rk, c \perp}$ according to Annex C5

²⁾ For lower compressive strengths resistances must be multiplied by the conversion factor according to Table C82. For stones with higher strengths, the shown values are valid without conversion.

Table C87: Displacements

Anchor size	h_{ef}	δ_N / N	δ_{N0}	$\delta_{N\infty}$	δ_v / V	δ_{v0}	$\delta_{v\infty}$
	[mm]	[mm/kN]	[mm]	[mm]	[mm/kN]	[mm]	[mm]
M8 – M12 / IG-M6 – IG-M10	all	0,13	0,13 * $N_{Rk} / 3,5$	2 * δ_{N0}	0,55	0,55 * $V_{Rk} / 3,5$	1,5 * δ_{v0}
M16					0,31	0,31 * $V_{Rk} / 3,5$	

Sikla Injection System VMU plus for masonry

Performances – Hollow clay brick Brique Creuse C40
Group factors, characteristic resistance and displacements

Annex C33

Brick type: Hollow clay brick Blocchi Leggeri

Table C88: Description

Brick type	Hollow clay brick Blocchi Leggeri	
Density	ρ [kg/dm ³]	≥ 0,60
Normalised mean compressive strength	f_b [N/mm ²]	≥ 12
Conversion factor for lower compressive strengths		$(f_b / 12)^{0,5} \leq 1,0$
Norm	[-]	EN 771-1:2011+A1:2015
Producer (country code)	[-]	e.g. Wienerberger (IT)
Brick dimensions	[mm]	250 x 120 x 250
Drilling method	[-]	Rotary drilling

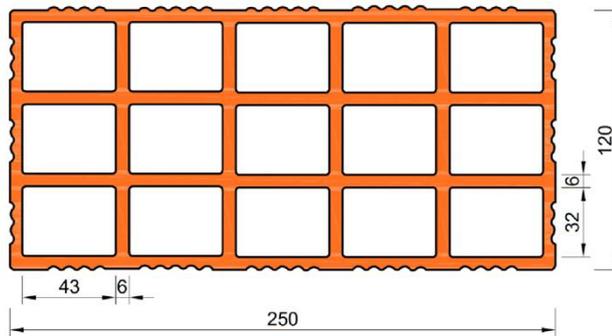


Table C89: Installation parameter

Anchor size		M8	M10	M12	M16	IG-M6	IG-M8	IG-M10
Installation torque	T_{inst} [Nm]	≤ 2	≤ 2	≤ 2	≤ 2	≤ 2	≤ 2	≤ 2
Edge distance	c_{cr} [mm]	120 (for shear loads perpendicular to the free edge: $c_{cr} = 250$)						
Minimum edge distance	c_{min} [mm]	60						
Spacing	$s_{cr, II}$ [mm]	250						
	$s_{cr, \perp}$ [mm]	250						
Minimum spacing	$s_{min, II}$ [mm]	100						
	$s_{min, \perp}$ [mm]	100						

Table C90: Reduction factors for single anchors at the edge

Tension load			Shear load					
			perpendicular to the free edge			perpendicular to the free edge		
	with $c \geq$	$\alpha_{edge, N}$		with $c \geq$	$\alpha_{edge, V \perp}$		with $c \geq$	$\alpha_{edge, V \parallel}$
	60	1,00		60	0,40		60	0,40
	120	1,00		250	1,00		120	1,00

Sikla Injection System VMU plus for masonry

Performances – Hollow clay brick Blocchi Leggeri
Description, installation parameters, reduction factors

Annex C34

Brick type: Hollow clay brick Blocchi Leggeri – continuation

Table C91: Factors for anchor groups

	Position parallel to horizontal joint			Position perpendicular to horizontal joint		
	with $c \geq$	with $s \geq$	$\alpha_{g II, N}$	with $c \geq$	with $s \geq$	$\alpha_{g \perp, N}$
Tension load	60	100	1,00	60	100	2,00
	120	250	2,00	120	250	2,00
Shear load perpendicular to the free edge	60	100	0,40	60	100	0,40
	250	100	1,00	250	100	1,00
	250	250	2,00	250	250	2,00
Shear load parallel to the free edge	60	100	0,40	60	100	0,40
	120	100	1,00	120	100	1,00
	120	250	2,00	120	250	2,00

Table C92: Characteristic resistance under tension and shear load

Anchor size	Sleeve	Effective anchorage depth	Characteristic resistance with $c \geq c_{cr}$ and $s \geq s_{cr}$						
			Use condition						
			d/d			w/d w/w			d/d w/d w/w
			24°C / 40°C	50°C / 80°C	72°C / 120°C	24°C / 40°C	50°C / 80°C	72°C / 120°C	all temperature ranges
		h_{ef}	$N_{Rk,b} = N_{Rk,p}^{1)}$						$V_{Rk,b}^{1)}$
		[mm]	[kN]						[kN]
Normalised mean compressive strength $f_b \geq 12 \text{ N/mm}^2$ ²⁾									
M8	VM-SH 12	80							
M8 / M10 / IG-M6	VM-SH 16	≥ 85	0,6	0,6	0,6	0,6	0,6	0,6	3,5
M12 / M16 / IG-M8 / IG-M10	VM-SH 20	≥ 85							

¹⁾ $N_{Rk,b,c} = N_{Rk,p,c}$ and $V_{Rk,c II} = V_{Rk,c \perp}$ according to Annex C5

²⁾ For lower compressive strengths resistances must be multiplied by the conversion factor according to Table C88. For stones with higher strengths, the shown values are valid without conversion.

Table C93: Displacements

Anchor size	h_{ef}	δ_N / N	δ_{N0}	$\delta_{N\infty}$	δ_v / V	δ_{v0}	$\delta_{v\infty}$
	[mm]	[mm/kN]	[mm]	[mm]	[mm/kN]	[mm]	[mm]
M8 – M12 / IG-M6 – IG-M10	all	0,13	0,13* N_{Rk} / 3,5	2* δ_{N0}	0,55	0,55* V_{Rk} / 3,5	1,5* δ_{v0}
M16					0,31	0,31* V_{Rk} / 3,5	

Sikla Injection System VMU plus for masonry

Performances – Hollow clay brick Blocchi Leggeri
Group factors, characteristic resistance and displacements

Annex C35

Brick type: Hollow Clay brick Doppio Uni

Table C94: Description

Brick type		Hollow clay brick Doppio Uni
Density	ρ [kg/dm ³]	$\geq 0,90$
Normalised mean compressive strength	f_b [N/mm ²]	≥ 28
Conversion factor for lower compressive strengths		$(f_b / 28)^{0,5} \leq 1,0$
Norm	[-]	EN 771-1:2011+A1:2015
Producer (country code)	[-]	e.g. Wienerberger (IT)
Brick dimensions	[mm]	250 x 120 x 120
Drilling method	[-]	Rotary drilling

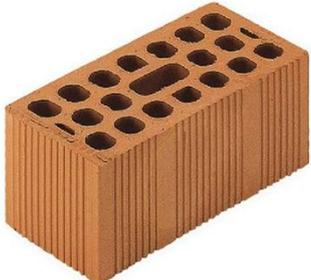
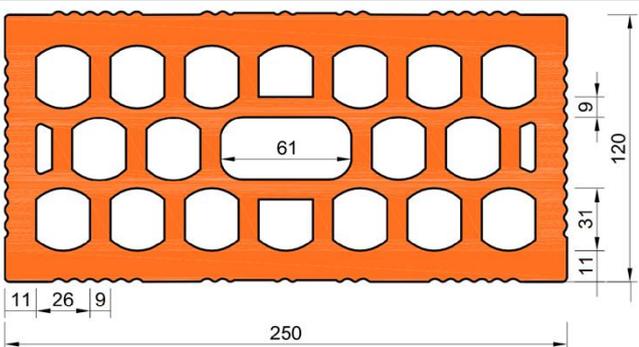






Table C95: Installation parameter

Anchor size		M8	M10	M12	M16	IG-M6	IG-M8	IG-M10
Installation torque	T_{inst} [Nm]	≤ 2	≤ 2	≤ 2	≤ 2	≤ 2	≤ 2	≤ 2
Edge distance	c_{cr} [mm]	120 (for shear loads perpendicular to the free edge: $c_{cr} = 250$)						
Minimum edge distance	c_{min} [mm]	100						
Spacing	$s_{cr, II}$ [mm]	250						
	$s_{cr, \perp}$ [mm]	120						
Minimum spacing	$s_{min, II}$ [mm]	100						
	$s_{min, \perp}$ [mm]	100						

Table C96: Reduction factors for single anchors at the edge

Tension load			Shear load					
			perpendicular to the free edge			perpendicular to the free edge		
with $c \geq$	$\alpha_{edge, N}$		with $c \geq$	$\alpha_{edge, V \perp}$		with $c \geq$	$\alpha_{edge, V \parallel}$	
100	1,00		100	0,50		100	1,00	
120	1,00		250	1,00		120	1,00	

Sikla Injection System VMU plus for masonry

Performances – Hollow Clay brick Doppio Uni
Description, installation parameters, reduction factors

Annex C36

Brick type: Hollow Clay brick Doppio Uni – continuation

Table C97: Factors for anchor groups

	Position parallel to horizontal joint				Position perpendicular to horizontal joint			
		with $c \geq$	with $s \geq$	$\alpha_{g II, N}$		with $c \geq$	with $s \geq$	$\alpha_{g L, N}$
Tension load		100	100	1,00		100	120	2,00
		120	250	2,00		120	120	2,00
Shear load perpendicular to the free edge		100	100	1,00		100	100	1,00
		250	250	2,00		250	120	2,00
Shear load parallel to the free edge		100	100	1,00		100	100	1,00
		120	250	2,00		120	120	2,00

Table C98: Characteristic resistance under tension and shear load

Anchor size	Sleeve	Effective anchorage depth	Characteristic resistance with $c \geq c_{cr}$ and $s \geq s_{cr}$						
			Use condition						
			d/d			w/d w/w			d/d w/d w/w
			24°C / 40°C	50°C / 80°C	72°C / 120°C	24°C / 40°C	50°C / 80°C	72°C / 120°C	all temperature ranges
		h_{ef}	$N_{Rk,b} = N_{Rk,p}^{1)}$						$V_{Rk,b}^{1)}$
		[mm]	[kN]						[kN]
Normalised mean compressive strength $f_b \geq 28 \text{ N/mm}^2$ ²⁾									
M8	VM-SH 12	80							
M8 / M10 / IG-M6	VM-SH 16	≥ 85	1,2	1,2	0,9	1,2	1,2	0,9	2,5
M12 / M16 / IG-M8 / IG-M10	VM-SH 20	≥ 85							

¹⁾ $N_{Rk,b,c} = N_{Rk,p,c}$ and $V_{Rk,c II} = V_{Rk,c \perp}$ according to Annex C5

²⁾ For lower compressive strengths resistances must be multiplied by the conversion factor according to Table C94. For stones with higher strengths, the shown values are valid without conversion.

Table C99: Displacements

Anchor size	h_{ef}	δ_N / N	δ_{N0}	$\delta_{N\infty}$	δ_V / V	δ_{V0}	$\delta_{V\infty}$
	[mm]	[mm/kN]	[mm]	[mm]	[mm/kN]	[mm]	[mm]
M8 – M12 / IG-M6 – IG-M10	all	0,13	0,13 * $N_{Rk} / 3,5$	2 * δ_{N0}	0,55	0,55 * $V_{Rk} / 3,5$	1,5 * δ_{V0}
M16					0,31	0,31 * $V_{Rk} / 3,5$	

Sikla Injection System VMU plus for masonry

Performances – Hollow Clay brick Doppio Uni
Group factors, characteristic resistance and displacements

Annex C37

Brick type: Hollow clay brick Coriso WS07 with insulation

Table C100: Description

Brick type		Hollow clay brick Coriso WS07
Insulation material		Rock wool
Density	ρ [kg/dm ³]	$\geq 0,55$
Normalised mean compressive strength	f_b [N/mm ²]	≥ 6
Conversion factor for lower compressive strengths		$(f_b / 6)^{0,5} \leq 1,0$
Norm	[-]	EN 771-1:2011+A1:2015
Producer (country code)	[-]	e.g. Unipor (DE)
Brick dimensions		[mm] 248 x 365 x 249
Drilling method		[-] Rotary drilling

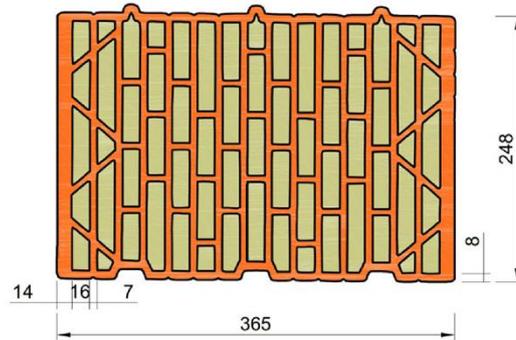


Table C101: Installation parameter

Anchor size		M8	M10	M12	M16	IG-M6	IG-M8	IG-M10
Installation torque	T_{inst} [Nm]	≤ 5	≤ 5	≤ 10	≤ 10	≤ 5	≤ 5	≤ 5
Edge distance	c_{cr} [mm]	120 (for shear loads perpendicular to the free edge: $c_{cr} = 250$)						
Minimum edge distance	c_{min} [mm]	50						
Spacing	$s_{cr, II}$ [mm]	250						
	$s_{cr, \perp}$ [mm]	250						
Minimum spacing	$s_{min, II}$ [mm]	50						
	$s_{min, \perp}$ [mm]	50						

Table C102: Reduction factors for single anchors at the edge

Tension load			Shear load					
			perpendicular to the free edge			perpendicular to the free edge		
	with $c \geq$	$\alpha_{edge, N}$		with $c \geq$	$\alpha_{edge, V, L}$		with $c \geq$	$\alpha_{edge, V, II}$
	50	1,00		50	0,30		50	1,00
	120	1,00		250	1,00		120	1,00

Sikla Injection System VMU plus for masonry

Performances – Hollow clay brick Coriso WS07
Description, installation parameters, reduction factors

Annex C38

Brick type: Hollow clay brick Coriso WS07 with insulation – continuation

Table C103: Factors for anchor groups

	Position parallel to horizontal joint			Position perpendicular to horizontal joint				
		with $c \geq$	with $s \geq$	$\alpha_{g II, N}$		with $c \geq$	with $s \geq$	$\alpha_{g \perp, N}$
Tension load		50	50	1,50		50	50	1,00
		120	250	2,00		120	250	2,00
Shear load perpendicular to the free edge		with $c \geq$	with $s \geq$	$\alpha_{g II, V \perp}$		with $c \geq$	with $s \geq$	$\alpha_{g \perp, V \perp}$
		50	50	0,40		50	50	0,40
		250	50	1,00		250	50	1,20
Shear load parallel to the free edge		with $c \geq$	with $s \geq$	$\alpha_{g II, V \parallel}$		with $c \geq$	with $s \geq$	$\alpha_{g \perp, V \parallel}$
		50	50	1,65		50	50	1,00
		120	250	2,00		120	250	2,00

Table C104: Characteristic resistance under tension and shear load

Anchor size	Sleeve VM-SH	Effective anchorage depth	Characteristic resistance with $c \geq c_{cr}$ and $s \geq s_{cr}$						
			Use condition						
			d/d			w/d w/w			d/d w/d w/w
			24°C / 40°C	50°C / 80°C	72°C / 120°C	24°C / 40°C	50°C / 80°C	72°C / 120°C	all temperature ranges
		h_{ef}	$N_{Rk,b} = N_{Rk,p}^{1)}$						$V_{Rk,b}^{1)}$
		[mm]	[kN]						[kN]
Normalised mean compressive strength $f_b \geq 6 \text{ N/mm}^2$ ²⁾									
M8	VM-SH 12	80							
M8 / M10 / IG-M6	VM-SH 16	≥ 85	1,5	1,5	1,5	1,5	1,5	1,5	5,0
M12 / M16 / IG-M8 / IG-M10	VM-SH 20	≥ 85							

¹⁾ $N_{Rk,b,c} = N_{Rk,p,c}$ and $V_{Rk,c \perp} = V_{Rk,c \perp}$ according to Annex C5

²⁾ For lower compressive strengths resistances must be multiplied by the conversion factor according to Table C100. For stones with higher strengths, the shown values are valid without conversion.

Table C105: Displacements

Anchor size	h_{ef}	δ_N / N	δ_{N0}	$\delta_{N\infty}$	δ_v / V	δ_{v0}	$\delta_{v\infty}$
	[mm]	[mm/kN]	[mm]	[mm]	[mm/kN]	[mm]	[mm]
M8 – M12 / IG-M6 – IG-M10	all	0,13	0,13 * $N_{Rk} / 3,5$	2 * δ_{N0}	0,55	0,55 * $V_{Rk} / 3,5$	1,5 * δ_{v0}
M16					0,31	0,31 * $V_{Rk} / 3,5$	

Sikla Injection System VMU plus for masonry

Performances – Hollow clay brick Coriso WS07 with insulation
Group factors, characteristic resistance and displacements

Annex C39

Brick type: Hollow clay brick T7 MW with insulation

Table C106: Description

Brick type	Hollow clay brick T7 MW		
Insulation material	Rock wool		
Density	ρ [kg/dm ³]	$\geq 0,59$	
Normalised mean compressive strength	f_b [N/mm ²]	≥ 8	
Conversion factor for lower compressive strengths	$(f_b / 8)^{0,5} \leq 1,0$		
Norm	[-]	EN 771-1:2011+A1:2015	
Producer (country code)	[-]	e.g. Wienerberger (DE)	
Brick dimensions	[mm]	248 x 365 x 249	
Drilling method	[-]	Rotary drilling	

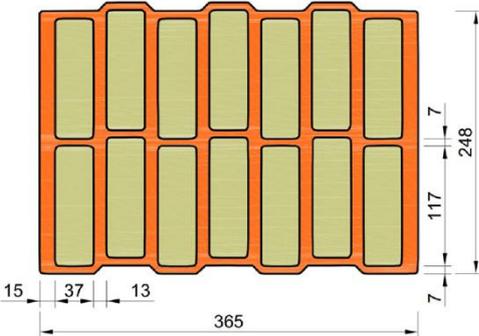





Table C107: Installation parameter

Anchor size		M8	M10	M12	M16	IG-M6	IG-M8	IG-M10
Installation torque	T_{inst} [Nm]	≤ 5	≤ 5	≤ 10	≤ 10	≤ 5	≤ 5	≤ 5
Edge distance (under fire exposure)	$c_{cr, (C_{cr,fi})}$ [mm]	120 (2 h_{ef}) (for shear loads perpendicular to the free edge: $c_{cr} = 250$)						
Minimum edge distance	c_{min} [mm]	50						
Spacing (under fire exposure)	$s_{cr, II} (s_{cr,fi, II})$ [mm]	250 (4 h_{ef})						
	$s_{cr, \perp} (s_{cr,fi, \perp})$ [mm]	250 (4 h_{ef})						
Minimum spacing	$s_{min, II}; s_{min, \perp}$ [mm]	50						

Table C108: Reduction factors for single anchors at the edge

Tension load			Shear load perpendicular to the free edge					
			perpendicular to the free edge			perpendicular to the free edge		
	with $c \geq$	$\alpha_{edge, N}$		with $c \geq$	$\alpha_{edge, VL}$		with $c \geq$	$\alpha_{edge, V II}$
	50	1,00		50	0,35		50	1,00
	120	1,00		250	1,00		120	1,00

Sikla Injection System VMU plus for masonry

Performances – Hollow clay brick T7 MW
Description, installation parameters, reduction factors

Annex C40

Brick type: Hollow clay brick T7 MW with insulation – continuation

Table C109: Factors for anchor groups

	Position parallel to horizontal joint				Position perpendicular to horizontal joint			
Tension load		with $c \geq$	with $s \geq$	$\alpha_{g II, N}$		with $c \geq$	with $s \geq$	$\alpha_{g \perp, N}$
		50	50	1,40		50	50	1,15
		120	250	2,00		120	250	2,00
Shear load perpendicular to the free edge		with $c \geq$	with $s \geq$	$\alpha_{g II, V \perp}$		with $c \geq$	with $s \geq$	$\alpha_{g \perp, V \perp}$
		50	50	0,60		50	50	0,40
		250	50	1,55		250	50	1,00
		250	250	2,00		250	250	2,00
Shear load parallel to the free edge		with $c \geq$	with $s \geq$	$\alpha_{g II, V \parallel}$		with $c \geq$	with $s \geq$	$\alpha_{g \perp, V \parallel}$
		50	50	2,00		50	50	1,20
		120	250	2,00		120	250	2,00

Table C110: Characteristic resistance under tension and shear load

Anchor size	Sleeve	Effective anchorage depth	Characteristic resistance with $c \geq c_{cr}$ and $s \geq s_{cr}$						
			Use condition						
			d/d			w/d			d/d
			w/w			w/w			w/w
			24°C / 40°C	50°C / 80°C	72°C / 120°C	24°C / 40°C	50°C / 80°C	72°C / 120°C	all temperature ranges
		h_{ef}	$N_{Rk,b} = N_{Rk,p}^{1)}$						$V_{Rk,b}^{1)}$
		[mm]	[kN]						[kN]
Normalised mean compressive strength $f_b \geq 8 \text{ N/mm}^2$ ²⁾									
M8	VM-SH 12	80							
M8 / M10/ IG-M6	VM-SH 16	≥ 85	2,0	2,0	1,5	2,0	2,0	1,5	3,0
M12 / IG-M8	VM-SH 20	≥ 85							
M16 / IG-M10	VM-SH 20	≥ 85							

¹⁾ $N_{Rk,b,c} = N_{Rk,p,c}$ and $V_{Rk,c \parallel} = V_{Rk,c \perp}$ according to Annex C5

²⁾ For lower compressive strengths resistances must be multiplied by the conversion factor according to Table C106. For stones with higher strengths, the shown values are valid without conversion.

Table C111: Displacements

Anchor size	h_{ef}	δ_N / N	δ_{N0}	$\delta_{N\infty}$	δ_V / V	δ_{V0}	$\delta_{V\infty}$
	[mm]	[mm/kN]	[mm]	[mm]	[mm/kN]	[mm]	[mm]
M8 – M12 / IG-M6 – IG-M10	all	0,13	0,13* N_{Rk} / 3,5	2* δ_{N0}	0,55	0,55* V_{Rk} / 3,5	1,5* δ_{V0}
M16					0,31	0,31* V_{Rk} / 3,5	

Sikla Injection System VMU plus for masonry

Performance
Performances – Hollow clay brick T7 MW
Group factors, characteristic resistances and displacements

Annex C41

Table C112: Characteristic resistance under fire exposure

Anchor size	Sleeve	Effective anchorage depth	Characteristic resistance $N_{Rk,b,fi} = N_{Rk,p,fi} = V_{Rk,b,fi}$			
			R30	R60	R90	R120
		h_{ef} [mm]	[kN]			
M8 / M10 /IG-M6	VM-SH 16	130	0,64	0,37	0,11	no performance assessed
M12 / M16 / IG-M8 IG-M10	VM-SH 20	≥ 130				

Sikla Injection System VMU plus for masonry

Performances – Hollow clay brick T7 MW with insulation
Characteristic resistance under fire exposure

Annex C42

Brick type: Hollow clay brick T8 P with insulation

Table C113: Description

Brick type	Hollow clay brick T8 P	
Insulation material	Perlite	
Density	ρ [kg/dm ³]	$\geq 0,56$
Normalised mean compressive strength	f_b [N/mm ²]	≥ 6
Conversion factor for lower compressive strengths	$(f_b / 6)^{0,5} \leq 1,0$	
Norm	[-]	EN 771-1:2011+A1:2015
Producer (country code)	[-]	e.g. Wienerberger (DE)
Brick dimensions	[mm]	248 x 365 x 249
Drilling method	[-]	Rotary drilling

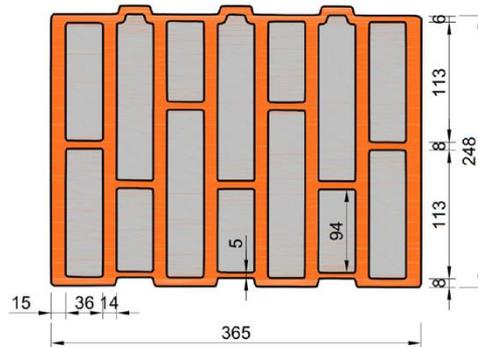


Table C114: Installation parameter

Anchor size		M8	M10	M12	M16	IG-M6	IG-M8	IG-M10
Installation torque	T_{inst} [Nm]	≤ 4	≤ 4	≤ 10	≤ 10	≤ 4	≤ 4	≤ 4
Edge distance	c_{cr} [mm]	120 (for shear loads perpendicular to the free edge: $c_{cr} = 250$)						
Minimum edge distance	c_{min} [mm]	50						
Spacing	$s_{cr, II}$ [mm]	250						
	$s_{cr, \perp}$ [mm]	250						
Minimum spacing	$s_{min, II}$ [mm]	50						
	$s_{min, \perp}$ [mm]	50						

Table C115: Reduction factors for single anchors at the edge

Tension load			Shear load					
			perpendicular to the free edge			perpendicular to the free edge		
	with $c \geq$	$\alpha_{edge, N}$		with $c \geq$	$\alpha_{edge, V, L}$		with $c \geq$	$\alpha_{edge, V, II}$
	50	1,00		50	0,25		50	1,00
	120	1,00		250	1,00		120	1,00

Sikla Injection System VMU plus for masonry

Performances – Hollow Clay brick T8 P with insulation
Description, installation parameters, reduction factors

Annex C43

Brick type: Hollow clay brick T8 P– continuation

Table C116: Factors for anchor groups








	Position parallel to horizontal joint			Position perpendicular to horizontal joint				
		with $c \geq$	with $s \geq$	$\alpha_{g II, N}$		with $c \geq$	with $s \geq$	$\alpha_{g \perp, N}$
Tension load		50	50	1,30		50	50	1,10
		120	250	2,00		120	250	2,00
Shear load perpendicular to the free edge		with $c \geq$	with $s \geq$	$\alpha_{g II, V \perp}$		with $c \geq$	with $s \geq$	$\alpha_{g \perp, V \perp}$
		50	50	0,40		50	50	0,30
		250	50	1,35		250	50	1,20
Shear load parallel to the free edge		with $c \geq$	with $s \geq$	$\alpha_{g II, V \parallel}$		with $c \geq$	with $s \geq$	$\alpha_{g \perp, V \parallel}$
		50	50	1,70		50	50	1,00
		120	250	2,00		120	250	2,00

Table C117: Characteristic resistance under tension and shear load

Anchor size	Sleeve	Effective anchorage depth	Characteristic resistance with $c \geq c_{cr}$ and $s \geq s_{cr}$						
			Use condition						
			d/d			w/d			d/d
			24°C / 40°C	50°C / 80°C	72°C / 120°C	24°C / 40°C	50°C / 80°C	72°C / 120°C	w/w
		h_{ef}	$N_{Rk,b} = N_{Rk,p}^{1)}$						$V_{Rk,b}^{1)}$
		[mm]	[kN]						[kN]
Normalised mean compressive strength $f_b \geq 6 \text{ N/mm}^2$ ²⁾									
M8	VM-SH 12	80							
M8 / M10 / IG-M6	VM-SH 16	≥ 85	1,5	1,5	1,5	1,5	1,5	1,5	4,5
M12 / IG-M8	VM-SH 20	≥ 85							
M16 / IG-M10	VM-SH 20	≥ 85	2,5	2,5	2,0	2,5	2,5	2,0	7,0

¹⁾ $N_{Rk,b,c} = N_{Rk,p,c}$ and $V_{Rk,c \parallel} = V_{Rk,c \perp}$ according to Annex C5

²⁾ For lower compressive strengths resistances must be multiplied by the conversion factor according to Table C113. For stones with higher strengths, the shown values are valid without conversion.

Table C118: Displacements

Anchor size	h_{ef}	δ_N / N	δ_{N0}	$\delta_{N\infty}$	δ_V / V	δ_{V0}	$\delta_{V\infty}$
	[mm]	[mm/kN]	[mm]	[mm]	[mm/kN]	[mm]	[mm]
M8 – M12 / IG-M6 – IG-M10	all	0,13	0,13 * $N_{Rk} / 3,5$	2 * δ_{N0}	0,55	0,55 * $V_{Rk} / 3,5$	1,5 * δ_{V0}
M16					0,31	0,31 * $V_{Rk} / 3,5$	

Sikla Injection System VMU plus for masonry

Performances – Hollow Clay brick T8 P with insulation
Group factors, characteristic resistance and displacements

Annex C44

Brick type: Hollow clay brick Thermoplan MZ90-G with insulation

Table C119: Installation parameter

Brick type		Hollow clay brick Thermoplan MZ90-G
Insulation material		Rock wool
Density	ρ [kg/dm ³]	$\geq 0,68$
Normalised mean compressive strength	f_b [N/mm ²]	≥ 12
Conversion factor for lower compressive strengths		$(f_b / 12)^{0,5} \leq 1,0$
Norm	[-]	EN 771-1:2011+A1:2015
Producer (country code)	[-]	e.g. Mein Ziegelhaus (DE)
Brick dimensions		[mm] 248 x 365 x 249
Drilling method		[-] Rotary drilling

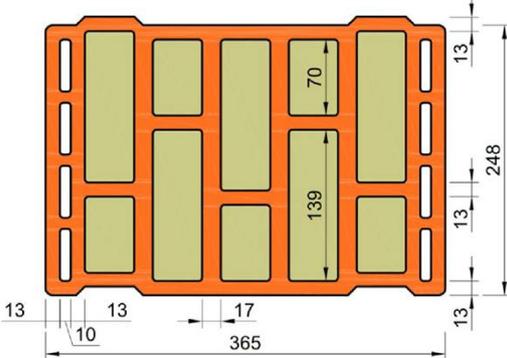






Table C120: Installation parameter

Anchor size		M8	M10	M12	M16	IG-M6	IG-M8	IG-M10
Installation torque	T_{inst} [Nm]	≤ 4	≤ 4	≤ 10	≤ 10	≤ 4	≤ 4	≤ 4
Edge distance	c_{cr} [mm]	120 (for shear loads perpendicular to the free edge: $c_{cr} = 250$)						
Minimum edge distance	c_{min} [mm]	50						
Spacing	$s_{cr, II}$ [mm]	250						
	$s_{cr, \perp}$ [mm]	250						
Minimum spacing	$s_{min, II}$ [mm]	50						
	$s_{min, \perp}$ [mm]	50						

Table C121: Reduction factors for single anchors at the edge

Tension load			Shear load					
			perpendicular to the free edge			perpendicular to the free edge		
	with $c \geq$	$\alpha_{edge, N}$		with $c \geq$	$\alpha_{edge, V, L}$		with $c \geq$	$\alpha_{edge, V, II}$
	50	1,00		50	0,25		50	1,00
	120	1,00		250	1,00		120	1,00

Sikla Injection System VMU plus for masonry

Performances – Hollow clay brick Thermoplan MZ90-G
Description, installation parameters, reduction factors

Annex C45

Brick type: Lochziegel Thermoplan MZ90-G – continuation

Table C122: Factors for anchor groups

	Position parallel to horizontal joint			Position perpendicular to horizontal joint				
Tension load		with $c \geq 50$	with $s \geq 50$	$\alpha_{g II, N}$		with $c \geq 50$	with $s \geq 50$	$\alpha_{g \perp, N}$
		120	250	1,00		120	250	1,00
Shear load perpendicular to the free edge		with $c \geq 50$	with $s \geq 50$	$\alpha_{g II, V \perp}$		with $c \geq 50$	with $s \geq 50$	$\alpha_{g \perp, V \perp}$
		250	50	0,75		50	50	0,50
		250	250	2,00		250	50	1,70
Shear load parallel to the free edge		with $c \geq 50$	with $s \geq 50$	$\alpha_{g II, V \parallel}$		with $c \geq 50$	with $s \geq 50$	$\alpha_{g \perp, V \parallel}$
		120	250	1,65		50	50	1,15
		120	250	2,00		120	250	2,00

Table C123: Characteristic resistance under tension and shear load

Anchor size	Sleeve	Effective anchorage depth	Characteristic resistance with $c \geq c_{cr}$ and $s \geq s_{cr}$						
			Use condition						
			d/d			w/d			d/d
			24°C / 40°C	50°C / 80°C	72°C / 120°C	24°C / 40°C	50°C / 80°C	72°C / 120°C	w/w
		h_{ef}	$N_{RK, b} = N_{RK, p}^{1)}$						$V_{RK, b}^{1)}$
		[mm]	[kN]						[kN]
Normalised mean compressive strength $f_b \geq 12 \text{ N/mm}^2$ ²⁾									
M8	VM-SH 12	80							
M8 / M10 / IG-M6	VM-SH 16	≥ 85	3,0	3,0	2,5	3,0	3,0	2,5	4,0
M12 / IG-M8	VM-SH 20	≥ 85							
M16 / IG-M10	VM-SH 20	≥ 85	3,5	3,5	3,0	3,5	3,5	3,0	7,5

¹⁾ $N_{RK, b, c} = N_{RK, p, c}$ and $V_{RK, c \parallel} = V_{RK, c \perp}$ according to Annex C5

²⁾ For lower compressive strengths resistances must be multiplied by the conversion factor according to Table C119. For stones with higher strengths, the shown values are valid without conversion.

Table C124: Displacements

Anchor size	h_{ef}	δ_N / N	δ_{N0}	$\delta_{N\infty}$	δ_V / V	δ_{V0}	$\delta_{V\infty}$
	[mm]	[mm/kN]	[mm]	[mm]	[mm/kN]	[mm]	[mm]
M8 – M12 / IG-M6 – IG-M10	all	0,13	0,13 * $N_{RK} / 3,5$	2 * δ_{N0}	0,55	0,55 * $V_{RK} / 3,5$	1,5 * δ_{V0}
M16					0,31	0,31 * $V_{RK} / 3,5$	


Sikla Injection System VMU plus for masonry

Performances – Hollow clay brick Thermoplan MZ90-G with insulation
Group factors, characteristic resistance and displacements

Annex C46

Brick type: Hollow clay brick Poroton FZ7,5 with insulation

Table C125: Description

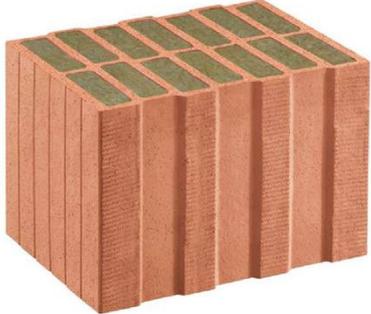Brick type	Hollow clay brick Poroton FZ7,5			
Insulation material	Rock wool			
Density	ρ [kg/dm ³]	$\geq 0,70$		
Normalised mean compressive strength	f_b [N/mm ²]	≥ 8		
Conversion factor for lower compressive strengths	$(f_b / 8)^{0,5} \leq 1,0$			
Norm	[-]			EN 771-1:2011+A1:2015
Producer (country code)	[-]			e.g. Schlagmann (DE)
Brick dimensions	[mm]			248 x 365 x 249
Drilling method	[-]			Rotary drilling

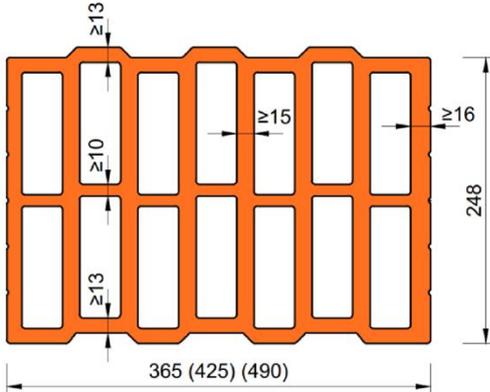





Table C126: Installation parameter

Anchor size		M8	M10	M12	M16	IG-M6	IG-M8	IG-M10
Installation torque	T_{inst} [Nm]	≤ 5	≤ 5	≤ 10	≤ 10	≤ 5	≤ 5	≤ 5
Edge distance (under fire exposure)	c_{cr} , ($c_{cr,fi}$) [mm]	120 (2 h_{ef}) (for shear loads perpendicular to the free edge: $c_{cr} = 250$)						
Minimum edge distance	c_{min} [mm]	50						
Spacing (under fire exposure)	$s_{cr, II}$ ($s_{cr,fi, II}$) [mm]	250 (4 h_{ef})						
	$s_{cr, \perp}$ ($s_{cr,fi, \perp}$) [mm]	250 (4 h_{ef})						
Minimum Spacing	$s_{min, II}$; $s_{min, \perp}$ [mm]	50						

Table C127: Reduction factors for single anchors at the edge

Tension load			Shear load					
			perpendicular to the free edge			perpendicular to the free edge		
with $c \geq$	$\alpha_{edge, N}$		with $c \geq$	$\alpha_{edge, VL}$		with $c \geq$	$\alpha_{edge, V II}$	
50	1,00		50	0,35		50	1,00	
120	1,00		250	1,00		120	1,00	

Sikla Injection System VMU plus for masonry

Performances – Hollow clay brick FZ7,5 MW
Description, installation parameters, reduction factors

Annex C47

Brick type: Hollow clay brick FZ7,5 with insulation – continuation

Table C128: Factors for anchor groups

	Position parallel to horizontal joint				Position perpendicular to horizontal joint			
		with c ≥ 50 120	with s ≥ 50 250	$\alpha_{g II, N}$ 1,40 2,00		with c ≥ 50 120	with s ≥ 50 250	$\alpha_{g \perp, N}$ 1,15 2,00
Tension load								
Shear load perpendicular to the free edge		with c ≥ 50	with s ≥ 50	$\alpha_{g II, V \perp}$ 0,60		with c ≥ 50	with s ≥ 50	$\alpha_{g \perp, V \perp}$ 0,40
		250	50	1,55		250	50	1,00
		250	250	2,00		250	250	2,00
Shear load parallel to the free edge		with c ≥ 50	with s ≥ 50	$\alpha_{g II, V \parallel}$ 2,00		with c ≥ 50	with s ≥ 50	$\alpha_{g \perp, V \parallel}$ 1,20
		120	250	2,00		120	250	2,00

Table C129: Characteristic resistance under tension and shear load

Anchor size	Sleeve	Effective anchorage depth	Characteristic resistance with $c \geq c_{cr}$ and $s \geq s_{cr}$						
			Use condition						
			d/d			w/d w/w			d/d w/d w/w
			24°C / 40°C	50°C / 80°C	72°C / 120°C	24°C / 40°C	50°C / 80°C	72°C / 120°C	all temperature ranges
		h_{ef} [mm]	$N_{RK,b} = N_{RK,p}^{1)}$ [kN]						$V_{RK,b}^{1)}$ [kN]
Normalised mean compressive strength $f_b \geq 8 \text{ N/mm}^2$ ²⁾									
M8	VM-SH 12	80							
M8 / M10 / IG-M6	VM-SH 16	≥ 85	2,0	2,0	1,5	2,0	2,0	1,5	3,0
M12 / IG-M8	VM-SH 20	≥ 85							
M16 / IG-M10	VM-SH 20	≥ 85							4,5

¹⁾ $N_{RK,b,c} = N_{RK,p,c}$ and $V_{RK,c \parallel} = V_{RK,c \perp}$ according to Annex C5

²⁾ For lower compressive strengths resistances must be multiplied by the conversion factor according to Table C125. For stones with higher strengths, the shown values are valid without conversion.

Table C130: Displacements

Anchor size	h_{ef} [mm]	δ_N / N [mm/kN]	δ_{N0} [mm]	$\delta_{N\infty}$ [mm]	δ_V / V [mm/kN]	δ_{V0} [mm]	$\delta_{V\infty}$ [mm]
M8 – M12 / IG-M6 – IG-M10	all	0,13	$0,13 \cdot N_{RK} / 3,5$	$2 \cdot \delta_{N0}$	0,55	$0,55 \cdot V_{RK} / 3,5$	$1,5 \cdot \delta_{V0}$
M16					0,31	$0,31 \cdot V_{RK} / 3,5$	

Table C131: Characteristic resistance under fire exposure

Anchor size	Sleeve	Effective anchorage depth h_{ef} [mm]	Characteristic resistance $N_{RK,b,fi} = N_{RK,p,fi} = V_{RK,b,fi}$			
			R30	R60	R90	R120
			[kN]			
M8 / M10 / IG-M6	VM-SH 16	130				
M12 / M16 / IG-M8 IG-M10	VM-SH 20	≥ 130	0,64	0,37	0,11	no performance assessed


Sikla Injection System VMU plus for masonry

Performance – Hollow clay brick FZ7,5 MW
Group factors, characteristic resistance and displacements

Annex C48

Brick type: Hollow clay brick Poroton FZ9 with insulation

Table C132: Description

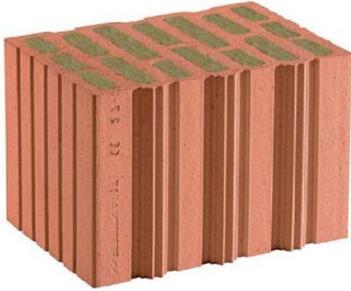Brick type	Hollow clay brick Poroton FZ9			
Insulation material	Rock wool			
Density	ρ [kg/dm ³]	$\geq 0,90$		
Normalised mean compressive strength	f_b [N/mm ²]	≥ 10		
Conversion factor for lower compressive strengths	$(f_b / 10)^{0,5} \leq 1,0$			
Norm	[-]			EN 771-1:2011+A1:2015
Producer (country code)	[-]			e.g. Schlagmann (DE)
Brick dimensions	[mm]			248 x 365 x 249
Drilling method	[-]			Rotary drilling

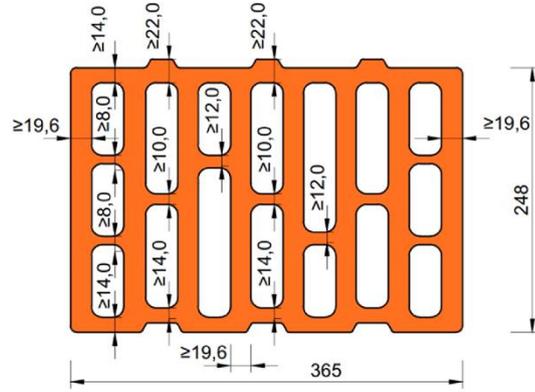





Table C133: Installation parameter

Anchor size		M8	M10	M12	M16	IG-M6	IG-M8	IG-M10
Installation torque	T_{inst} [Nm]	≤ 5	≤ 5	≤ 10	≤ 10	≤ 5	≤ 5	≤ 5
Edge distance (under fire exposure)	$c_{cr, (c_{cr,fi})}$ [mm]	120 (2 h_{ef}) (for shear loads perpendicular to the free edge: $c_{cr} = 250$)						
Minimum edge distance	c_{min} [mm]	50						
Spacing (under fire exposure)	$s_{cr, II} (s_{cr,fi, II})$ [mm]	250 (4 h_{ef})						
	$s_{cr, \perp} (s_{cr,fi, \perp})$ [mm]	250 (4 h_{ef})						
Minimum spacing	$s_{min, II}; s_{min, \perp}$ [mm]	50						

Table C134: Reduction factors for single anchors at the edge

Tension load			Shear load					
			perpendicular to the free edge			perpendicular to the free edge		
with $c \geq$	$\alpha_{edge, N}$		with $c \geq$	$\alpha_{edge, V, L}$		with $c \geq$	$\alpha_{edge, V, II}$	
50	1,00		50	0,35		50	1,00	
120	1,00		250	1,00		120	1,00	

Sikla Injection System VMU plus for masonry

Performances – Hollow clay brick FZ9 MW with insulation
Description, installation parameters, reduction factors

Annex C49

Brick type: Hollow clay brick FZ9 with insulation – continuation

Table C135: Factors for anchor groups







	Position parallel to horizontal joint				Position perpendicular to horizontal joint			
		with $c \geq$ 50 120	with $s \geq$ 50 250	$\alpha_{g II, N}$ 1,40 2,00		with $c \geq$ 50 120	with $s \geq$ 50 250	$\alpha_{g \perp, N}$ 1,15 2,00
Tension load								
Shear load perpendicular to the free edge		with $c \geq$ 50	with $s \geq$ 50	$\alpha_{g II, V \perp}$ 0,60		with $c \geq$ 50	with $s \geq$ 50	$\alpha_{g \perp, V \perp}$ 0,40
		250	50	1,55		250	50	1,00
		250	250	2,00		250	250	2,00
Shear load parallel to the free edge		with $c \geq$ 50	with $s \geq$ 50	$\alpha_{g II, V \parallel}$ 2,00		with $c \geq$ 50	with $s \geq$ 50	$\alpha_{g \perp, V \parallel}$ 1,20
		120	250	2,00		120	250	2,00

Table C136: Characteristic resistance under tension and shear load

Anchor size	Sleeve	Effective anchorage depth	Characteristic resistance with $c \geq c_{cr}$ and $s \geq s_{cr}$						
			Use condition						
			d/d			w/d w/w			d/d w/d w/w
			24°C / 40°C	50°C / 80°C	72°C / 120°C	24°C / 40°C	50°C / 80°C	72°C / 120°C	all temperature ranges
		h_{ef}	$N_{RK, b} = N_{RK, p}^{1)}$					$V_{RK, b}^{1)}$	
		[mm]	[kN]					[kN]	
Normalised mean compressive strength $f_b \geq 10 \text{ N/mm}^2$ ²⁾									
M8	VM-SH 12	80	2,0	2,0	1,5	2,0	2,0	1,5	
M8 / M10 / IG-M6	VM-SH 16	≥ 85							3,0
M12 / IG-M8	VM-SH 20	≥ 85							
M16 / IG-M10	VM-SH 20	≥ 85							

¹⁾ $N_{RK, b, c} = N_{RK, p, c}$ and $V_{RK, c \parallel} = V_{RK, c \perp}$ according to Annex C5

²⁾ For lower compressive strengths resistances must be multiplied by the conversion factor according to Table C132. For stones with higher strengths, the shown values are valid without conversion.

Table C137: Displacements

Anchor size	h_{ef}	δ_N / N	δ_{N0}	$\delta_{N\infty}$	δ_v / V	δ_{v0}	$\delta_{v\infty}$
	[mm]	[mm/kN]	[mm]	[mm]	[mm/kN]	[mm]	[mm]
M8 – M12 / IG-M6 – IG-M10	all	0,13	$0,13 \cdot N_{RK} / 3,5$	$2 \cdot \delta_{N0}$	0,55	$0,55 \cdot V_{RK} / 3,5$	$1,5 \cdot \delta_{v0}$
M16					0,31	$0,31 \cdot V_{RK} / 3,5$	

Table C138: Characteristic resistance under fire exposure

Anchor size	Sleeve	Effective anchorage depth	Characteristic resistance $N_{RK, b, fi} = N_{RK, p, fi} = V_{RK, b, fi}$				
			h_{ef}	R30	R60	R90	R120
			[mm]	[kN]			
M8 / M10 / IG-M6	VM-SH 16	130	0,64	0,37	0,11	no performance assessed	
M12 / M16 / IG-M8 IG-M10	VM-SH 20	≥ 130					

Sikla Injection System VMU plus for masonry

Performance – Hollow clay brick FZ9
Group factors, characteristic resistance and displacements

Annex C50

Brick type: Hollow clay brick Poroton S9 with insulation

Table C139: Description

Brick type		Hollow clay brick Poroton S9
Insulation material		Perlite
Density	ρ [kg/dm ³]	$\geq 0,85$
Normalised mean compressive strength	f_b [N/mm ²]	≥ 12
Conversion factor for lower compressive strengths		$(f_b / 12)^{0,5} \leq 1,0$
Norm	[-]	EN 771-1:2011+A1:2015
Producer (country code)	[-]	e.g. Schlagmann (DE)
Brick dimensions		[mm] 248 x 365 x 249
Drilling method		[-] Rotary drilling

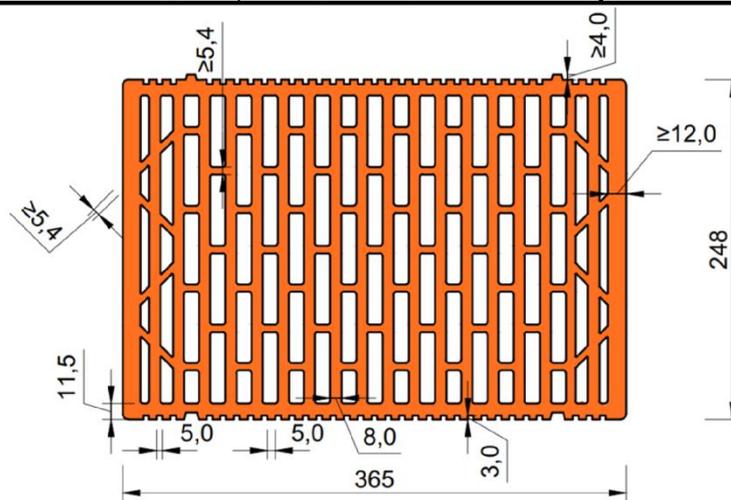
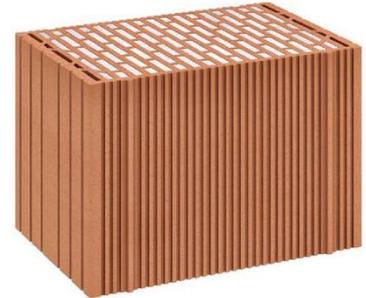


Table C140: Installation parameter

Anchor size		M8	M10	M12	M16	IG-M6	IG-M8	IG-M10
Installation torque	T_{inst} [Nm]	≤ 5	≤ 5	≤ 10	≤ 10	≤ 5	≤ 5	≤ 5
Edge distance	c_{cr} [mm]	120 (for shear loads perpendicular to the free edge: $c_{cr} = 250$)						
Minimum edge distance	c_{min} [mm]	50						
Spacing	$s_{cr, II}$ [mm]	250						
	$s_{cr, \perp}$ [mm]	250						
Minimum spacing	$s_{min, II}$ [mm]	50						
	$s_{min, \perp}$ [mm]	50						

Table C141: Reduction factors for single anchors at the edge

Tension load			Shear load					
			perpendicular to the free edge			perpendicular to the free edge		
	with $c \geq$	$\alpha_{edge, N}$		with $c \geq$	$\alpha_{edge, V, L}$		with $c \geq$	$\alpha_{edge, V, II}$
	50	1,00		50	0,30		50	1,00
	120	1,00		250	1,00		120	1,00

Sikla Injection System VMU plus for masonry

Performances – Hollow Clay brick Poroton S9
Description, installation parameters, reduction factors

Annex C51

Brick type: Hollow clay brick Poroton S9 with insulation – continuation

Table C142: Factors for anchor groups

	Position parallel to horizontal joint			Position perpendicular to horizontal joint		
	with $c \geq$	with $s \geq$	$\alpha_{g II, N}$	with $c \geq$	with $s \geq$	$\alpha_{g \perp, N}$
Tension load	50	50	1,50	50	50	1,00
	120	250	2,00	120	250	2,00
Shear load perpendicular to the free edge	with $c \geq$	with $s \geq$	$\alpha_{g II, V \perp}$	with $c \geq$	with $s \geq$	$\alpha_{g \perp, V \perp}$
	50	50	0,40	50	50	0,40
	250	50	1,00	250	50	1,20
	250	250	2,00	250	250	2,00
Shear load parallel to the free edge	with $c \geq$	with $s \geq$	$\alpha_{g II, V II}$	with $c \geq$	with $s \geq$	$\alpha_{g \perp, V II}$
	50	50	1,65	50	50	1,00
	120	250	2,00	120	250	2,00

Table C143: Characteristic resistance under tension and shear load

Anchor size	Sleeve	Effective anchorage depth	Characteristic resistance with $c \geq c_{cr}$ and $s \geq s_{cr}$							
			Use condition							
			d/d			w/d			d/d	
			w/w			w/w		w/w		d/d
			24°C / 40°C	50°C / 80°C	72°C / 120°C	24°C / 40°C	50°C / 80°C	72°C / 120°C	all temperature ranges	
		h_{ef}	$N_{Rk,b} = N_{Rk,p}^{1)}$						$V_{Rk,b}^{1)}$	
		[mm]	[kN]						[kN]	
Normalised mean compressive strength $f_b \geq 12 \text{ N/mm}^2$ ²⁾										
M8	VM-SH 12	80								
M8 / M10 / IG-M6	VM-SH 16	≥ 85	1,5	1,5	1,5	1,5	1,5	1,5	5,0	
M12 / M16 / IG-M8 / IG-M10	VM-SH 20	≥ 85								

¹⁾ $N_{Rk,b,c} = N_{Rk,p,c}$ and $V_{Rk,c \perp} = V_{Rk,c \perp}$ according to Annex C5

²⁾ For lower compressive strengths resistances must be multiplied by the conversion factor according to Table C139. For stones with higher strengths, the shown values are valid without conversion.

Table C144: Displacements

Anchor size	h_{ef}	δ_N / N	δ_{N0}	$\delta_{N\infty}$	δ_V / V	δ_{V0}	$\delta_{V\infty}$
	[mm]	[mm/kN]	[mm]	[mm]	[mm/kN]	[mm]	[mm]
M8 – M12 / IG-M6 – IG-M10	all	0,13	0,13 * $N_{Rk} / 3,5$	2 * δ_{N0}	0,55	0,55 * $V_{Rk} / 3,5$	1,5 * δ_{V0}
M16					0,31	0,31 * $V_{Rk} / 3,5$	

Sikla Injection System VMU plus for masonry

Performances – Hollow Clay brick Poroton S9
Group factors, characteristic resistance and displacements

Annex C52

Brick type: Hollow clay brick Thermopor TV8+ with insulation

Table C145: Description

Brick type		Hollow clay brick Thermopor TV8+
Insulation material		Rock wool
Density	ρ [kg/dm ³]	$\geq 0,70$
Normalised mean compressive strength	f_b [N/mm ²]	≥ 10
Conversion factor for lower compressive strengths		$(f_b / 10)^{0,5} \leq 1,0$
Norm	[-]	EN 771-1:2011+A1:2015
Producer (country code)	[-]	e.g. THERMOPOR GmbH (DE)
Brick dimensions		[mm] 247 x 365 x 249
Drilling method		[-] Rotary drilling

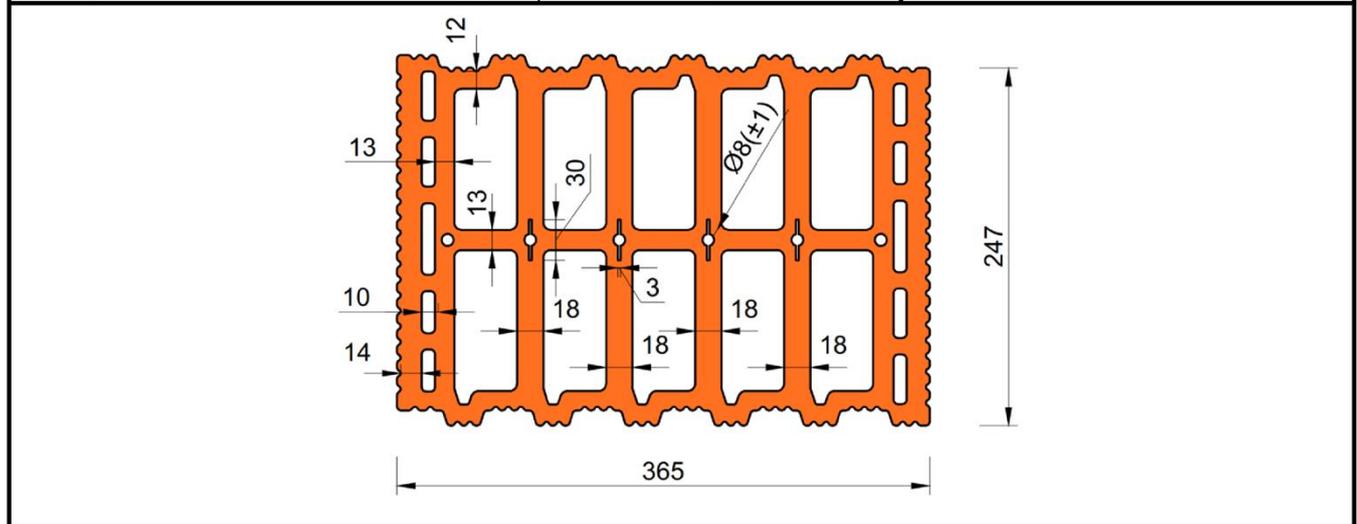
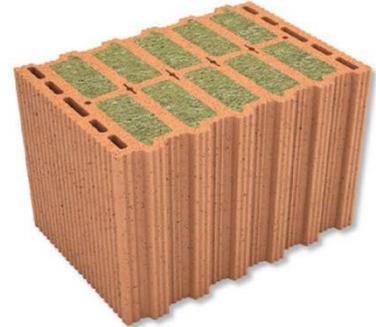


Table C146: Installation parameter

Anchor size		M8	M10	M12	M16	IG-M6	IG-M8	IG-M10
Installation torque	T_{inst} [Nm]	≤ 4	≤ 4	≤ 10	≤ 10	≤ 4	≤ 4	≤ 4
Edge distance	c_{cr} [mm]	120 (for shear loads perpendicular to the free edge: $c_{cr} = 250$)						
Minimum edge distance	c_{min} [mm]	50						
Spacing	$s_{cr, II}$ [mm]	250						
	$s_{cr, \perp}$ [mm]	250						
Minimum spacing	$s_{min, II}$ [mm]	50						
	$s_{min, \perp}$ [mm]	50						

Table C147: Reduction factors for single anchors at the edge

Tension load			Shear load					
			perpendicular to the free edge			perpendicular to the free edge		
with $c \geq$	$\alpha_{edge, N}$		with $c \geq$	$\alpha_{edge, VL}$		with $c \geq$	$\alpha_{edge, V II}$	
50	1,00		50	0,25		50	1,00	
120	1,00		250	1,00		120	1,00	

Sikla Injection System VMU plus for masonry

Performances – Hollow Clay brick Thermopor TV8+
Description, installation parameters, reduction factors

Annex C53

Brick type: Hollow clay brick Thermopor TV8+ with insulation – continuation

Table C148: Factors for anchor groups

	Position parallel to horizontal joint				Position perpendicular to horizontal joint			
Tension load		with $c \geq$	with $s \geq$	$\alpha_{g II, N}$		with $c \geq$	with $s \geq$	$\alpha_{g \perp, N}$
		50	50	1,00		50	50	1,00
		120	250	2,00		120	250	2,00
Shear load perpendicular to the free edge		with $c \geq$	with $s \geq$	$\alpha_{g II, V \perp}$		with $c \geq$	with $s \geq$	$\alpha_{g \perp, V \perp}$
		50	50	0,75		50	50	0,50
		250	50	2,00		250	50	1,70
		250	250	2,00		250	250	2,00
Shear load parallel to the free edge		with $c \geq$	with $s \geq$	$\alpha_{g II, V \parallel}$		with $c \geq$	with $s \geq$	$\alpha_{g \perp, V \parallel}$
		50	50	1,65		50	50	1,15
		120	250	2,00		120	250	2,00

Table C149: Characteristic resistance under tension and shear load

Anchor size	Sleeve	Effective anchorage depth	Characteristic resistance with $c \geq c_{cr}$ and $s \geq s_{cr}$						
			Use condition						
			d/d			w/d w/w			d/d w/d w/w
			24°C / 40°C	50°C / 80°C	72°C / 120°C	24°C / 40°C	50°C / 80°C	72°C / 120°C	all temperature ranges
		h_{ef}	$N_{Rk, b} = N_{Rk, p}^{1)}$						$V_{Rk, b}^{1)}$
		[mm]	[kN]						[kN]
Normalised mean compressive strength $f_b \geq 10 \text{ N/mm}^2$ ²⁾									
M8	VM-SH 12	80							
M8 / M10 / IG-M6	VM-SH 16	≥ 85	3,0	3,0	2,5	3,0	3,0	2,5	3,5
M12 / IG-M8	VM-SH 20	≥ 85							
M16 / IG-M10	VM-SH 20	≥ 85	3,5	3,5	3,0	3,5	3,5	3,0	7,0

¹⁾ $N_{Rk, b, c} = N_{Rk, p, c}$ and $V_{Rk, c, II} = V_{Rk, c, \perp}$ according to Annex C5

²⁾ For lower compressive strengths resistances must be multiplied by the conversion factor according to Table C145. For stones with higher strengths, the shown values are valid without conversion.

Table C150: Displacements

Anchor size	h_{ef}	δ_N / N	δ_{N0}	$\delta_{N\infty}$	δ_v / V	δ_{v0}	$\delta_{v\infty}$
	[mm]	[mm/kN]	[mm]	[mm]	[mm/kN]	[mm]	[mm]
M8 – M12 / IG-M6 – IG-M10	all	0,13	$0,13 \cdot N_{Rk} / 3,5$	$2 \cdot \delta_{N0}$	0,55	$0,55 \cdot V_{Rk} / 3,5$	$1,5 \cdot \delta_{v0}$
M16					0,31	$0,31 \cdot V_{Rk} / 3,5$	

Sikla Injection System VMU plus for masonry

Performances – Hollow Clay brick Thermopor TV8+
Group factors, characteristic resistance and displacements

Annex C54

Brick type: Hollow light weight concrete brick HBL 16DF

Table C151: Description

Brick type		Hollow light weight concrete brick HBL 16DF
Density	ρ [kg/dm ³]	$\geq 1,0$
Normalised mean compressive strength	f_b [N/mm ²]	$\geq 3,1$
Conversion factor for lower compressive strengths		$(f_b / 3,1)^{0,5} \leq 1,0$
Norm	[-]	EN 771-3:2011+A1:2015
Producer (country code)	[-]	e.g. KLB Klimaleichtblock (DE)
Brick dimensions	[mm]	500 x 250 x 240
Drilling method	[-]	Rotary drilling

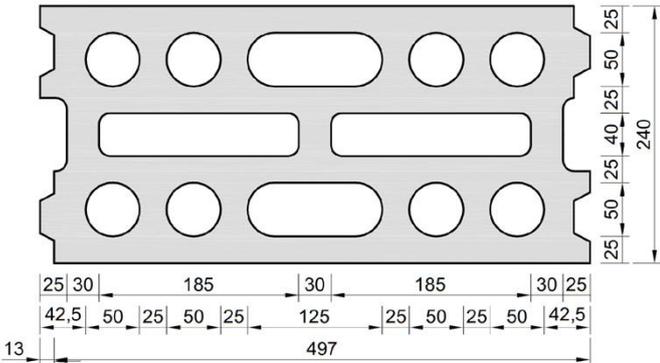






Table C152: Installation parameter

Anchor size		M8	M10	M12	M16	IG-M6	IG-M8	IG-M10
Installation torque	T_{inst} [Nm]	≤ 2	≤ 2	≤ 5	≤ 5	≤ 2	≤ 5	≤ 5
Edge distance (under fire exposure)	$c_{Cr}, (c_{Cr,fi})$ [mm]	120 (2 h_{ef}) (for shear loads perpendicular to the free edge: $c_{Cr} = 250$)						
Minimum edge distance	c_{min} [mm]	50						
Spacing (under fire exposure)	$s_{Cr, II} (s_{Cr,fi, II})$ [mm]	500 (4 h_{ef})						
	$s_{Cr, \perp} (s_{Cr,fi, \perp})$ [mm]	250 (4 h_{ef})						
Minimum spacing	$s_{min, II}; s_{min, \perp}$ [mm]	50						

Table C153: Reduction factors for single anchors at the edge

Tension load			Shear load					
			perpendicular to the free edge			perpendicular to the free edge		
with $c \geq$	$\alpha_{edge,N}$		with $c \geq$	$\alpha_{edge,V \perp}$		with $c \geq$	$\alpha_{edge,V II}$	
50	1,00		50	0,30		50	1,00	
120	1,00		250	1,00		120	1,00	

Sikla Injection System VMU plus for masonry

Performances – Hollow light weight concrete brick HBL 16DF
Description, installation parameters, reduction factors

Annex C55

Brick type: Hollow light weight concrete brick HBL 16DF – continuation

Table C154: Factors for anchor groups

	Position parallel to horizontal joint				Position perpendicular to horizontal joint			
Tension load		with c ≥ 50	with s ≥ 50	$\alpha_{g II, N}$		with c ≥ 50	with s ≥ 50	$\alpha_{g \perp, N}$
		120	500	2,00		120	250	2,00
Shear load perpendicular to the free edge		with c ≥ 50	with s ≥ 50	$\alpha_{g II, V \perp}$		with c ≥ 50	with s ≥ 50	$\alpha_{g \perp, V \perp}$
		120	50	0,60		120	50	0,35
		120	500	2,00		120	250	1,15
Shear load parallel to the free edge		with c ≥ 50	with s ≥ 50	$\alpha_{g II, V \parallel}$		with c ≥ 50	with s ≥ 50	$\alpha_{g \perp, V \parallel}$
		120	250	1,30		120	250	1,00
		120	500	2,00		120	250	2,00

Table C155: Characteristic resistance under tension and shear load

Anchor size	Sleeve VM-SH	Effective anchorage depth	Characteristic resistance with $c \geq c_{cr}$ and $s \geq s_{cr}$						
			Use condition						
			d/d			w/d w/w			d/d w/d w/w
			24°C / 40°C	50°C / 80°C	72°C / 120°C	24°C / 40°C	50°C / 80°C	72°C / 120°C	all temperature ranges
		h_{ef}	$N_{Rk,b} = N_{Rk,p}^{1)}$						$V_{Rk,b}^{1)}$
		[mm]	[kN]						[kN]
Normalised mean compressive strength $f_b \geq 3,1 \text{ N/mm}^2$ ²⁾									
M8 / M10/IG-M6	VM-SH 16	≥ 85	1,2	1,2	0,9	1,2	1,2	0,9	2,0
M12 / IG-M8	VM-SH 20	≥ 85	1,5	1,5	1,2	1,5	1,5	1,2	3,0
M16 / IG-M10	VM-SH 20	≥ 85							5,0

¹⁾ $N_{Rk,b,c} = N_{Rk,p,c}$ and $V_{Rk,c \parallel} = V_{Rk,c \perp}$ according to Annex C5

²⁾ For lower compressive strengths resistances must be multiplied by the conversion factor according to Table C151. For stones with higher strengths, the shown values are valid without conversion.

Table C156: Displacements

Anchor size	h_{ef}	δ_N / N	δ_{N0}	$\delta_{N\infty}$	δ_v / V	δ_{v0}	$\delta_{v\infty}$
	[mm]	[mm/kN]	[mm]	[mm]	[mm/kN]	[mm]	[mm]
M8 – M12 / IG-M6 – IG-M10	all	0,13	$0,13 \cdot N_{Rk} / 3,5$	$2 \cdot \delta_{N0}$	0,55	$0,55 \cdot V_{Rk} / 3,5$	$1,5 \cdot \delta_{v0}$
M16					0,31	$0,31 \cdot V_{Rk} / 3,5$	

Table C157: Characteristic resistance under fire exposure

Anchor size	Sleeve	Effective anchorage depth	Characteristic resistance			
			$N_{Rk,b,fi} = N_{Rk,p,fi} = V_{Rk,b,fi}$			
			h_{ef}	R30	R60	R90
		[mm]	[kN]			
M8 / M10 / IG-M6	VM-SH 16	130	0,29	0,21	no performance assessed	no performance assessed
M12 / IG-M8	VM-SH 20	≥ 130				
M16 / IG-M10	VM-SH 20	≥ 130	0,29	0,21	0,12	

Sikla Injection System VMU plus for masonry

Performances – Hollow light weight concrete brick HBL 16DF
Group factors, characteristic resistance and displacements

Annex C56

Brick type: Hollow concrete brick Bloc Creux B40

Table C158: Description

Brick type		Hollow concrete brick Bloc Creux B40
Density	ρ [kg/dm ³]	≥ 0,8
Normalised mean compressive strength	f_b [N/mm ²]	≥ 5,2
Conversion factor for lower compressive strengths		$(f_b / 5,2)^{0,5} \leq 1,0$
Norm	[-]	EN 771-3:2011+A1:2015
Producer (country code)	[-]	e.g. Leroux (FR)
Brick dimensions	[mm]	500 x 200 x 200
Drilling method	[-]	Rotary drilling

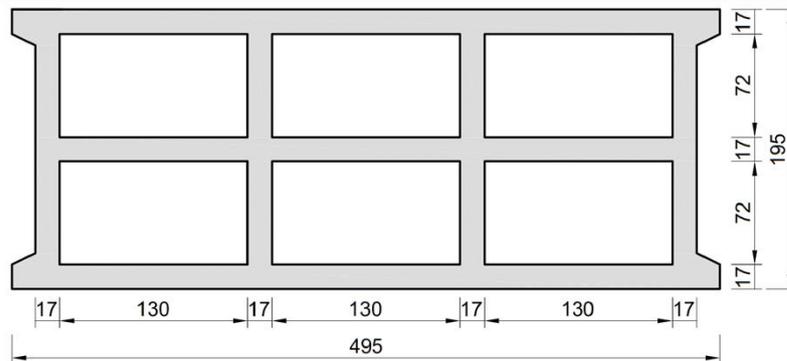


Table C159: Installation parameter

Anchor size		M8	M10	M12	M16	IG-M6	IG-M8	IG-M10
Installation torque	T_{inst} [Nm]	≤ 4	≤ 4	≤ 4	≤ 4	≤ 4	≤ 4	≤ 4
Edge distance	c_{cr} [mm]	120 (for shear loads perpendicular to the free edge: $c_{cr} = 170$)						
Minimum edge distance	c_{min} [mm]	50						
Spacing	$s_{cr, II}$ [mm]	170						
	$s_{cr, \perp}$ [mm]	200						
Minimum spacing	$s_{min, II}$ [mm]	50						
	$s_{min, \perp}$ [mm]							

Table C160: Reduction factors for single anchors at the edge

Tension load			Shear load					
			perpendicular to the free edge			perpendicular to the free edge		
	with $c \geq$	$\alpha_{edge, N}$		with $c \geq$	$\alpha_{edge, V \perp}$		with $c \geq$	$\alpha_{edge, V II}$
	50	1,00		50	0,35		50	1,00
	120	1,00		170	1,00		120	1,00

Sikla Injection System VMU plus for masonry

Performances – Hollow concrete brick Bloc Creux B40
Description, installation parameters, reduction factors

Annex C57

Brick type: Hollow concrete brick Bloc Creux B40 – continuation

Table C161: Factors for anchor groups

	Position parallel to horizontal joint			Position perpendicular to horizontal joint				
Tension load		with $c \geq$	with $s \geq$	$\alpha_{g II, N}$		with $c \geq$	with $s \geq$	$\alpha_{g \perp, N}$
		50	50	1,50		50	50	1,40
		50	170	2,00		50	200	2,00
		120	170	2,00		120	200	2,00
Shear load perpendicular to the free edge		with $c \geq$	with $s \geq$	$\alpha_{g II, V \perp}$		with $c \geq$	with $s \geq$	$\alpha_{g \perp, V \perp}$
		50	50	0,55		50	50	0,35
		120	50	1,30		120	50	0,85
		120	170	2,00		120	200	2,00
Shear load parallel to the free edge		with $c \geq$	with $s \geq$	$\alpha_{g II, V \parallel}$		with $c \geq$	with $s \geq$	$\alpha_{g \perp, V \parallel}$
		50	50	1,10		50	50	1,00
		120	170	2,00		50	200	2,00
		120	170	2,00		120	200	2,00

Table C162: Characteristic resistance under tension and shear load

Anchor size	Sleeve VM-SH	Effective anchorage depth	Characteristic resistance with $c \geq c_{cr}$ and $s \geq s_{cr}$						
			Use condition						
			d/d			w/d w/w			d/d w/d w/w
			24°C / 40°C	50°C / 80°C	72°C / 120°C	24°C / 40°C	50°C / 80°C	72°C / 120°C	all temperature ranges
		h_{ef}	$N_{Rk, b} = N_{Rk, p}^{1)}$						$V_{Rk, b}^{1)}$
		[mm]	[kN]						[kN]
Normalised mean compressive strength $f_b \geq 5,2 \text{ N/mm}^2$ ²⁾									
M8 / M10 IG-M6	VM-SH 16	130	2,0	1,5	1,2	2,0	1,5	1,2	6,0
M12 / M16 IG-M8 / IG-M10	VM-SH 20	≥ 130							

¹⁾ $N_{Rk, b, c} = N_{Rk, p, c}$ and $V_{Rk, c \perp} = V_{Rk, c \perp}$ according to Annex C5

²⁾ For lower compressive strengths resistances must be multiplied by the conversion factor according to Table C158. For stones with higher strengths, the shown values are valid without conversion.

Table C163: Displacements

Anchor size	h_{ef}	δ_N / N	δ_{N0}	$\delta_{N\infty}$	δ_v / V	δ_{v0}	$\delta_{v\infty}$
	[mm]	[mm/kN]	[mm]	[mm]	[mm/kN]	[mm]	[mm]
M8 – M12 / IG-M6 – IG-M10	all	0,13	0,13 * $N_{Rk} / 3,5$	2 * δ_{N0}	0,55	0,55 * $V_{Rk} / 3,5$	1,5 * δ_{v0}
M16					0,31	0,31 * $V_{Rk} / 3,5$	

Sikla Injection System VMU plus for masonry

Performances – Hollow concrete brick Bloc Creux B40
Group factors, characteristic resistance and displacements

Annex C58

Brick type: Solid light weight concrete brick VBL

Table C164: Description

Brick type		Solid light weight concrete brick VBL
Density	ρ [kg/dm ³]	$\geq 0,6$
Normalised mean compressive strength	f_b [N/mm ²]	≥ 2
Conversion factor for lower compressive strengths		$(f_b / 2)^{0,5} \leq 1,0$
Norm	[-]	EN 771-3:2011+A1:2015
Producer (country code)	[-]	e.g. Bisotherm (DE)
Brick dimensions	[mm]	$\geq 240 \times 300 \times 113$
Drilling method	[-]	Rotary drilling



Table C165: Installation parameter

Anchor size		M8	M10	M12	M16	IG-M6	IG-M8	IG-M10
Installation torque	T_{inst} [Nm]	≤ 2						
Edge distance	c_{cr} [mm]	150						
Minimum edge distance	c_{min} [mm]	60						
Spacing	$s_{cr, II}$ [mm]	300						
	$s_{cr, \perp}$ [mm]	300						
Minimum spacing	$s_{min, II}$ [mm]	120						
	$s_{min, \perp}$ [mm]	120						

Table C166: Reduction factors for single anchors at the edge










Tension load			Shear load					
			perpendicular to the free edge			perpendicular to the free edge		
with $c \geq$	$\alpha_{edge, N}$		with $c \geq$	$\alpha_{edge, V \perp}$		with $c \geq$	$\alpha_{edge, V \parallel}$	
60	1,00		60	0,25		60	0,40	
150	1,00		150	1,00		100	1,00	

Table C167: Factors for anchor groups

	Position parallel to horizontal joint				Position perpendicular to horizontal joint			
	with $c \geq$	with $s \geq$	$\alpha_{g, II, N}$		with $c \geq$	with $s \geq$	$\alpha_{g, L, N}$	
Tension load	60	120	1,00		60	120	1,00	
	150	300	2,00		150	300	2,00	
Shear load perpendicular to the free edge	60	120	0,25		60	120	0,25	
	150	120	1,00		150	120	1,00	
	150	300	2,00		150	300	2,00	
Shear load parallel to the free edge	60	120	0,40		60	120	0,40	
	100	120	1,00		100	120	1,00	
	150	300	2,00		150	300	2,00	

Sikla Injection System VMU plus for masonry

Performances – Solid light weight concrete brick VBL
Description, installation parameters, reduction- and group factors

Annex C59

Brick type: Solid light weight concrete brick VBL – continuation

Table C168: Characteristic resistance under tension and shear load

Anchor size	Sleeve VM-SH	Effective anchorage depth	Characteristic resistance with $c \geq c_{cr}$ and $s \geq s_{cr}$						
			Use condition						
			d/d			w/d w/w			d/d w/d w/w
			24°C / 40°C	50°C / 80°C	72°C / 120°C	24°C / 40°C	50°C / 80°C	72°C / 120°C	all temperature ranges
h_{ef}	$N_{Rk,b} = N_{Rk,p}^{1)}$						$V_{Rk,b}^{1)}$		
[mm]	[kN]						[kN]		
Normalised mean compressive strength $f_b \geq 2 \text{ N/mm}^2$ ²⁾									
M8	-	80	3,0	2,5	2,0	2,5	2,0	1,5	3,0
M10 / IG-M6	-	90							
M12 / M16 / IG-M8 / IG-M10	-	100							
M8	VM-SH 12	80	2,5	2,5	2,0	2,5	2,0	1,5	
M8 / M10 IG-M6	VM-SH 16	≥ 85							
M12 / M16 / IG-M8 / IG-M10	VM-SH 20	≥ 85							

¹⁾ $N_{Rk,b,c} = N_{Rk,p,c}$ and $V_{Rk,c,II} = V_{Rk,c,I}$ according to Annex C5

²⁾ For lower compressive strengths resistances must be multiplied by the conversion factor according to Table C164. For stones with higher strengths, the shown values are valid without conversion.

Table C169: Displacements

Anchor size	h_{ef}	δ_N / N	δ_{N0}	$\delta_{N\infty}$	δ_v / V	δ_{v0}	$\delta_{v\infty}$
	[mm]	[mm/kN]	[mm]	[mm]	[mm/kN]	[mm]	[mm]
M8 – M12 / IG-M6 – IG-M10	all	0,10	0,10* N_{Rk} / 3,5	2* δ_{N0}	0,30	0,30* V_{Rk} / 3,5	1,5* δ_{v0}
M16					0,10	0,10* V_{Rk} / 3,5	

Sikla Injection System VMU plus for masonry

Performances – Solid light weight concrete brick VBL
Characteristic resistance and displacements

Annex C60